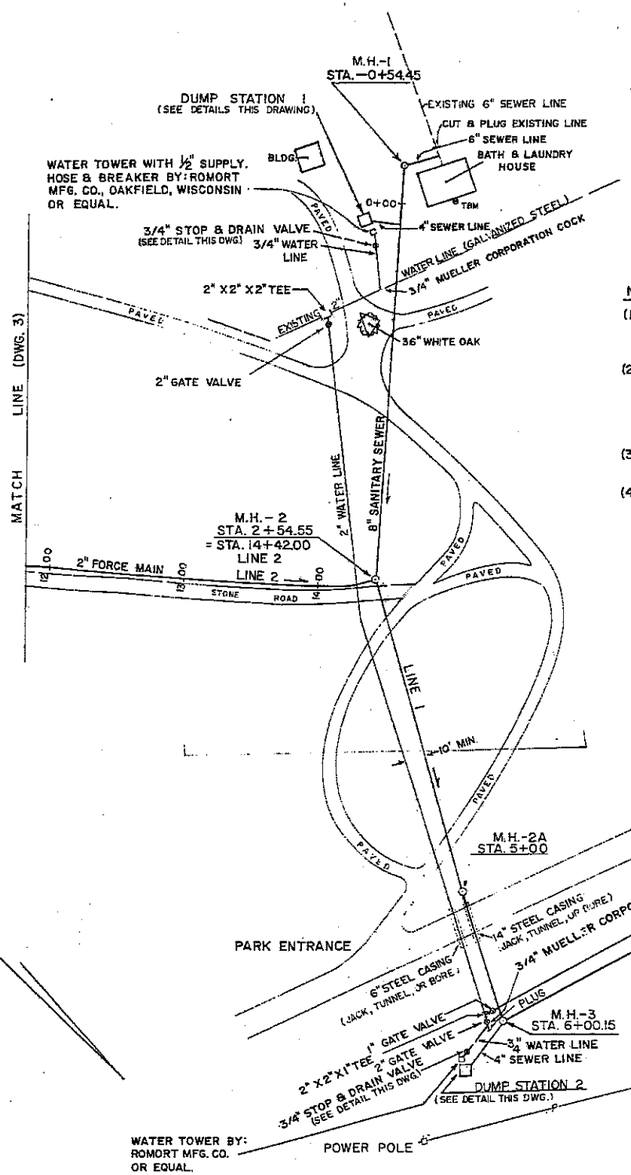

TBM
TOP CONCRETE STEP N.-E. CORNER AT LAUNDRY DOOR. ELEV. 2381.49'

NOTE:

(1) EXISTING WATER LINE LOCATION IS APPROXIMATE AND IS TO BE VERIFIED IN THE FIELD.

(2) OWNER IS TO SUPPLY ¾", 1" & 2" GALVANIZED STEEL PIPE FOR THE PROPOSED WATER LINES. INSTALLATION AND FITTINGS ARE TO BE SUPPLIED BY THE CONTRACTOR.

(3) WATER LINES SHALL HAVE A MINIMUM OF 36" COVER.

(4) FOR SEWER LINE PROFILE, SEE DWG. 2094-2-4.

DUMP STATION DETAIL

SCALE: ¾" = 1'

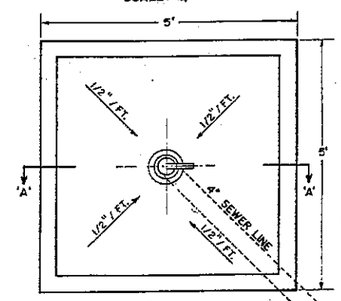

PLAN

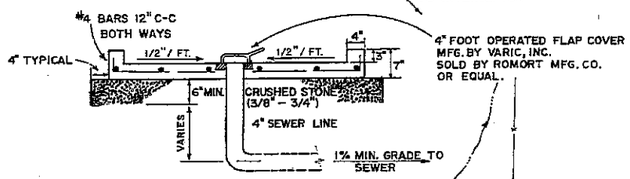

SECTION 'A'-'A'

TO INTERCEPTOR

NOTE:

(1) WATER TOWER AND FLAP COVER FROM EXISTING DUMP STATION MAY BE USED FOR ONE OF THE PROPOSED DUMP STATIONS. CONTRACTOR TO PROVIDE NEW WATER TOWER AND FLAP COVER FOR OTHER DUMP STATION.

(2) ALL CONCRETE IS CLASS "C".

STOP & DRAIN VALVE DETAIL

NO SCALE

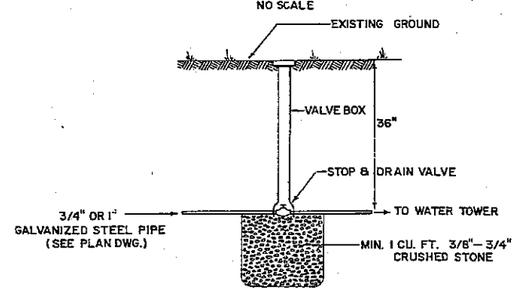

NOTE:

CONTRACTOR SHALL PROVIDE THE OWNER WITH A WRENCH TO OPERATE THE STOP & DRAIN VALVES FROM ABOVE GRADE.

CALVIN D. UPTON REGISTERED 7829 STATE OF WEST VIRGINIA PROFESSIONAL ENGINEER

C. Dean Upton

PLAN SHOWING PROPOSED SEWER LINE SERVING FACILITIES AT

BABCOCK STATE PARK

CLIFFTOP FAYETTE CO. W. VA

HOLLEY, KENNEY, SCHOTT

ENGINEERS · ARCHITECTS · SURVEYORS · PLANNERS

PITTSBURGH, PA. BECKLEY, W. VA.

DIVISION OF BABCOCK CONTRACTORS INC.

SCALE 1" = 50'

DR. REC / ALL DATE 10-76

CH. CDU DATE 10-76

2094-2-2

CODE 3-8

DWG. No.	DESCRIPTION

REVISION DESCRIPTION

B.M.	SHEET No.	REV.	DATE	BY	(M) DATE

H.K.S. APPROVALS CLIENT

THIS DRAWING, INCLUDING THE INFORMATION IT CONTAINS, IS THE PROPERTY OF HOLLEY, KENNEY, SCHOTT, INC. IT IS SUBMITTED ONLY IN CONNECTION WITH THE TRANSACTION TO WHICH IT PERTAINS AND MUST NOT BE USED IN ANY MANNER DETRIMENTAL TO THE INTERESTS OF HOLLEY, KENNEY, SCHOTT, INC. THIS DRAWING IS NOT TO BE COPIED OR REPRODUCED AND MUST BE RETURNED UPON REQUEST.

EK01004076

11-3