



State of West Virginia
 Department of Administration
 Purchasing Division
 2019 Washington Street East
 Post Office Box 50130
 Charleston, WV 25305-0130

Request for Quotation

RFQ NUMBER
 DCH12107

PAGE
 1

ADDRESS CORRESPONDENCE TO ATTENTION OF
 SHELLY MURRAY
 304-558-8801

VENDOR

RFQ COPY
 TYPE NAME/ADDRESS HERE

SHIP TO

DIVISION OF CULTURE & HISTORY
 CULTURAL CENTER
 1900 KANAWHA BOULEVARD, EAST
 CHARLESTON, WV
 25305-0300 558-0220

DATE PRINTED	TERMS OF SALE	SHIP VIA	F.O.B.	FREIGHT TERMS
05/30/2012				

BID OPENING DATE: 06/13/2012 BID OPENING TIME 01:30PM

LINE	QUANTITY	UOP	CAT. NO.	ITEM NUMBER	UNIT PRICE	AMOUNT
ADDENDUM NO. 1						
1. QUESTIONS AND ANSWERS ARE ATTACHED. 2. PRE-BID SIGN IN SHEETS ARE ATTACHED. 3. ADDENDUM ACKNOWLEDGEMENT IS ATTACHED. THIS DOCUMENT SHOULD BE SIGNED AND RETURNED WITH YOUR BID. FAILURE TO SIGN AND RETURN MAY RESULT IN DISQUALIFICATION OF YOUR BID.						
EXHIBIT 10						
REQUISITION NO. DCH12107						
ADDENDUM ACKNOWLEDGEMENT						
I HEREBY ACKNOWLEDGE RECEIPT OF THE FOLLOWING CHECKED ADDENDUM(S) AND HAVE MADE THE NECESSARY REVISIONS TO MY PROPOSAL, PLANS AND/OR SPECIFICATION, ETC.						
ADDENDUM NO.'S:						
NO. 1.....						
NO. 2.....						
NO. 3.....						
NO. 4.....						
NO. 5.....						
I UNDERSTAND THAT FAILURE TO CONFIRM THE RECEIPT OF THE ADDENDUM(S) MAY BE CAUSE FOR REJECTION OF BIDS.						

SEE REVERSE SIDE FOR TERMS AND CONDITIONS

SIGNATURE	TELEPHONE	DATE
TITLE	FEIN	ADDRESS CHANGES TO BE NOTED ABOVE

WHEN RESPONDING TO RFQ, INSERT NAME AND ADDRESS IN SPACE ABOVE LABELED 'VENDOR'

GENERAL TERMS & CONDITIONS
REQUEST FOR QUOTATION (RFQ) AND REQUEST FOR PROPOSAL (RFP)

1. Awards will be made in the best interest of the State of West Virginia.
2. The State may accept or reject in part, or in whole, any bid.
3. Prior to any award, the apparent successful vendor must be properly registered with the Purchasing Division and have paid the required \$125 fee.
4. All services performed or goods delivered under State Purchase Order/Contracts are to be continued for the term of the Purchase Order/Contracts, contingent upon funds being appropriated by the Legislature or otherwise being made available. In the event funds are not appropriated or otherwise available for these services or goods this Purchase Order/Contract becomes void and of no effect after June 30.
5. Payment may only be made after the delivery and acceptance of goods or services.
6. Interest may be paid for late payment in accordance with the *West Virginia Code*.
7. Vendor preference will be granted upon written request in accordance with the *West Virginia Code*.
8. The State of West Virginia is exempt from federal and state taxes and will not pay or reimburse such taxes.
9. The Director of Purchasing may cancel any Purchase Order/Contract upon 30 days written notice to the seller.
10. The laws of the State of West Virginia and the *Legislative Rules* of the Purchasing Division shall govern the purchasing process.
11. Any reference to automatic renewal is hereby deleted. The Contract may be renewed only upon mutual written agreement of the parties.
12. **BANKRUPTCY:** In the event the vendor/contractor files for bankruptcy protection, the State may deem this contract null and void, and terminate such contract without further order.
13. **HIPAA BUSINESS ASSOCIATE ADDENDUM:** The West Virginia State Government HIPAA Business Associate Addendum (BAA), approved by the Attorney General, is available online at www.state.wv.us/admin/purchase/vrc/hipaa.html and is hereby made part of the agreement provided that the Agency meets the definition of a Cover Entity (45 CFR §160.103) and will be disclosing Protected Health Information (45 CFR §160.103) to the vendor.
14. **CONFIDENTIALITY:** The vendor agrees that he or she will not disclose to anyone, directly or indirectly, any such personally identifiable information or other confidential information gained from the agency, unless the individual who is the subject of the information consents to the disclosure in writing or the disclosure is made pursuant to the agency's policies, procedures, and rules. Vendor further agrees to comply with the Confidentiality Policies and Information Security Accountability Requirements, set forth in <http://www.state.wv.us/admin/purchase/privacy/noticeConfidentiality.pdf>.
15. **LICENSING:** Vendors must be licensed and in good standing in accordance with any and all state and local laws and requirements by any state or local agency of West Virginia, including, but not limited to, the West Virginia Secretary of State's Office, the West Virginia Tax Department, and the West Virginia Insurance Commission. The vendor must provide all necessary releases to obtain information to enable the director or spending unit to verify that the vendor is licensed and in good standing with the above entities.
16. **ANTITRUST:** In submitting a bid to any agency for the State of West Virginia, the bidder offers and agrees that if the bid is accepted the bidder will convey, sell, assign or transfer to the State of West Virginia all rights, title and interest in and to all causes of action it may now or hereafter acquire under the antitrust laws of the United States and the State of West Virginia for price fixing and/or unreasonable restraints of trade relating to the particular commodities or services purchased or acquired by the State of West Virginia. Such assignment shall be made and become effective at the time the purchasing agency tenders the initial payment to the bidder.

I certify that this bid is made without prior understanding, agreement, or connection with any corporation, firm, limited liability company, partnership, or person or entity submitting a bid for the same material, supplies, equipment or services and is in all respects fair and without collusion or fraud. I further certify that I am authorized to sign the certification on behalf of the bidder or this bid.

INSTRUCTIONS TO BIDDERS

1. Use the quotation forms provided by the Purchasing Division. Complete all sections of the quotation form.
2. Items offered must be in compliance with the specifications. Any deviation from the specifications must be clearly indicated by the bidder. Alternates offered by the bidder as **EQUAL** to the specifications must be clearly defined. A bidder offering an alternate should attach complete specifications and literature to the bid. The Purchasing Division may waive minor deviations to specifications.
3. Unit prices shall prevail in case of discrepancy. All quotations are considered F.O.B. destination unless alternate shipping terms are clearly identified in the quotation.
4. All quotations must be delivered by the bidder to the office listed below prior to the date and time of the bid opening. Failure of the bidder to deliver the quotations on time will result in bid disqualifications: Department of Administration, Purchasing Division, 2019 Washington Street East, P.O. Box 50130, Charleston, WV 25305-0130.
5. Communication during the solicitation, bid, evaluation or award periods, except through the Purchasing Division, is strictly prohibited (W.Va. C.S.R. §148-1-6.6).



State of West Virginia
 Department of Administration
 Purchasing Division
 2019 Washington Street East
 Post Office Box 50130
 Charleston, WV 25305-0130

Request for Quotation

RFQ NUMBER
DCH12107

PAGE
2

ADDRESS CORRESPONDENCE TO ATTENTION OF
SHELLY MURRAY
304-558-8801

RFQ COPY
 TYPE NAME/ADDRESS HERE

VENDOR

DIVISION OF CULTURE & HISTORY
 CULTURAL CENTER
 1900 KANAWHA BOULEVARD, EAST
 CHARLESTON, WV
 25305-0300 558-0220

SHIP TO

DATE PRINTED	TERMS OF SALE	SHIP VIA	F.O.B.	FREIGHT TERMS
05/30/2012				

BID OPENING DATE: 06/13/2012 BID OPENING TIME 01:30PM

LINE	QUANTITY	UOP	CAT NO	ITEM NUMBER	UNIT PRICE	AMOUNT
<p>VENDOR MUST CLEARLY UNDERSTAND THAT ANY VERBAL REPRESENTATION MADE OR ASSUMED TO BE MADE DURING ANY ORAL DISCUSSION HELD BETWEEN VENDOR'S REPRESENTATIVES AND ANY STATE PERSONNEL IS NOT BINDING. ONLY THE INFORMATION ISSUED IN WRITING AND ADDED TO THE SPECIFICATION BY AN OFFICIAL ADDENDUM IS BINDING.</p> <p>..... SIGNATURE</p> <p>..... COMPANY</p> <p>..... DATE</p> <p>NOTE: THIS ADDENDUM ACKNOWLEDGEMENT SHOULD BE SUBMITTED WITH THE BID.</p> <p>REV. 09/21/2009</p> <p>END OF ADDENDUM NO. 1</p>						

SEE REVERSE SIDE FOR TERMS AND CONDITIONS

SIGNATURE	TELEPHONE	DATE
TITLE	FEIN	ADDRESS CHANGES TO BE NOTED ABOVE

WHEN RESPONDING TO RFQ, INSERT NAME AND ADDRESS IN SPACE ABOVE LABELED 'VENDOR'

RFQ# DCH12107

WV Museum Collections Storage

Question 1 -4-C-6

6. Design carriages to allow the shelving uprights to recess and interlock into the carriages a minimum of 3/4 inch (19MM). Top mount carriages are unacceptable.

Only one manufacture constructs their carriages with a 3/4" high lip running the length of the carriage. This lip has been added to give the carriage additional strength, since steel becomes stronger every time it is folded/bent.

The shelving is not recessing and interlocking into the carriage. There shelving will mount to the top of the carriage identical to all other manufactures.

Having only a 3/4" lip running the length of the carriage becomes a tipping point/shear point in a seismic environment.

Borroughs carriage is designed to not need the 3/4" lip running the length of the carriage. Our carriages have only 0.10" deflection with a maximum carriage load (1,000 lbs. per ft) based on our widest rail spacing.

Agreed – carriage design submitted meets approved specifications for top mount carriages – maximum carriage load (at a minimum is 1,000 lbs. per foot) based on widest rail spacing.

Question 2 – 4-G-5

5. Optional Mechanical Sweep and Safety Stop (Non-Powered).

Borroughs offers a mechanical Safety Sweep (Non-Powered). The safety sweep is recommended for high activity systems, with multiple users.

Your application will not be in this manner. The Safety Sweep adds a significant additional cost to each carriage, and most importantly adds growth to each carriage.

With the Safety Sweep you will be adding 1" in growth to each side of the carriage (2" total) Do you have this much additional space?

Most importantly when the Safety Sweep is engaged the carriage comes to an abrupt/immediate stop, which could cause damage to the collection

Agreed; remove Optional Mechanical Sweep and Safety Stop from RFQ, page 21, G. Accessories, Number 5.

Question 3 – C-2 (Page 27)

- 2) Wheels – Hardened steel wheels with (2) permanently shielded ball bearing assemblies. Provide spacers on both sides of wheel bearings to eliminate all friction between wheels and carriage. Provide four (4) roller-type guide bearings and two (2) anti-tip mechanisms per track assembly at the leading edge of the carriage. Guide rollers to be adjustable to insure proper alignment of carriages.

This contradicts earlier specifications for carriage drive. A carriage guidance with roller-type guide bearings is patented and can only be offered by one manufacturer.

This should be removed from specifications. This manufacturer only recommends using roller bearing guides when carriages are in excess of 30'.

Agreed – omit from RFQ, page 27, c.2. Roller bearing guides are to be used only when carriages exceed 30'. Please note, this section is for Row C, Art Rack.

Question 4 – This section talking about the shelving should be reversed - #2 is 4 Post and #3 is B-Span.

Page 25, Section E, Shelving Units Installation, 6a(2) and (3), Omit reference to four-post shelving in (2). Item 3 is Wide-Span shelving for Row A. Four-post is in Row B.

Question 5 – On page 13 under finishes (section G), you indicate a minimum of 20 end panels. A) Do you want an end panel on each range? B) Do you want 2 on the dual entry system? Please confirm location and quantity of end panels.

This section refers to the paint finishes – not the number of end panels.

In reference to the end panels, Row A will require end panels on all carriages – one sided facing aisleway. Row B requires end panels on both end of carriages. All end panels require both movement controls as identified in Section 4, SYSTEM DESCRIPTION, Item D (page 13) and safety lock as identified in Section 4.F.2 (page 13).

Question 6 – On page 18 under aisle (section 4.A.1.), you indicate the size of aisle you want for each section. How many aisles do you want in each section?

The maximum aisle width within any given carriage as it is opened is identified on page 19, Section 4 MANUFACTURED COMPONENTS, a.1. The aisle requirements are as follows:

Row A – 8 feet (96 inches)

Row B – 6 feet (72 inches)

Row C – 4 feet (48 inches)

Question 7 - On page 20 under drive/guide system (section D), you indicate that the system can be either line shaft or synchro drive. To clarify, it can be either one?

Yes, more importantly, Vendor must provide drive system which prevents carriage whipping, binding and excessive wheel/rail wear, even under unbalanced load conditions. The load capacity must also be met in accordance with the specifications.

Question 8 – On page 21 under Accessories (section G), you mention anti-tip devices. You also mention anti-tip channels need to be in the rail provided on page 18 (section 4.2.B). Please clarify what type of anti-tip devices you are requesting, if any?

As per page 21, Section G, Accessories, Item 2 - Provide Manufacturer's standard fixtures – Vendor should specify. Note: page 18, Item 2.A and page 19, Item 4.A.7

Question 9 - On page 22 under Construction Schedule (section 2.B.1) you indicate approximate duration on site to be 210 days. A) Is it 210 business days or 210 calendar days? B) Define minimum crew in section 2.B.1.C on page 23?

A. 210 Calendar days. Minimum crew would be an agreed upon number between Vendor and Owner.

Question 10 – On page 24 under Shelving Units Installation (section E.3), you discuss canopy tops. You indicate no tops in section A but some in section B as indicated below. I cannot find where canopy tops are mentioned again. Does that mean no canopy tops for section B?


Row A will not require canopy tops; Row B consists of 4-post units, Drawer units, Garment units, Rolled Textile units that do require top support and be enclosed.

Question 11 - On page 24 under Shelving Units Installation (section E.6.a), you discuss the heavy duty Cantilever Shelving. A) How deep are the single/double cantilever sections you are requesting? You do not mention shelves for these units. B) Do they have shelves?


As stated on page 26, E6a 1), Cantilever shelving for the first unit is one (1) single-sided four (4) feet (48 inches) deep unit and two (2) double-sided, four (4) feet (48 inches) deep unit. The double-sided unit will be placed on a carriage unit capable of holding it. The Cantilever shelving does not have shelves, rather they are designed with posts that have adjustable heavy duty arms extending the distance of the base/not protruding out from the carriage. The requirement is for five (5) posts per unit with 5 adjustable arms per post. Posts and arms

are required to hold (at a minimum) the same weight bearing loads as the carriages and shelving units. (1,000 lbs. per linear foot).

Single sided

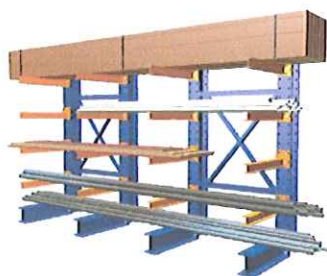

Double sided

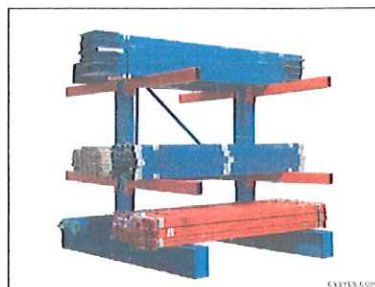

Question 12 - On page 26 under Open Uprights (section 2), you indicate 30" wide shelving as well as 109" and 48" wide. A) Did you mean 30"D? B) The 4-Post Shelving you are specifying does not come in a width of 109" (widest standard width is 48") What width sections do you want to comprise your 4-post ranges? C) Do you want a canopy top?

Yes, 30" deep is the standard for Row B. See page 27 and 28 Chart for number of carriages, size of carriage, and shelf type for Row A and B.

Question 13 - On page 26 under Four-Post Units for Garment Racks (section 3), you have the same issue with the width of 4-post shelving. A) What width sections do you want to comprise your Garment Rack ranges? B) You indicate 2 shelves. Is it 2 shelves (base and middle shelf) plus a canopy top or just 2 shelves?

The Garment Racks are 30" deep and lengths are 109" and 48". See page 27 and 28 Chart. Page 26, E.6.b.3 also provides specifications for Garment Rack rod assembly units (G9 and G4). Since all units in Row B are enclosed on top and the base of the carriage unit is finished and enclosed, the specification is for two (2) shelves per unit. Omit (4) from letter i). These shelves should be adjustable for each unit so they can be changed according to the storage needs of the Collection.

Question 14 - On page 26 under Rolled Textile Storage (section 4), A) please describe the type of storage unit you are looking for or provide picture? B) You indicate 8 textile rods per drawer. Based on the width of each rod (conduit), the diameter of the rolled textile/painting would have to be less than 2 inches thick. What are you storing in these units?

See picture below providing visual reference for the Rolled Textile Storage Unit. Also, refer to page 32 of the RFQ for descriptive. The museum's collection of textiles will be stored in these units (i.e., quilts, coverlets, bedspreads, etc.).



Question 15 - On page 26 under Pull-Out Shelving (section 5), you request 30 three inch high shelves per section. The shelf on 4-post shelving has a $\frac{3}{4}$ " to $1\frac{1}{4}$ " profile. With 30 shelves, that is a total of $22\frac{1}{2}$ " to $37\frac{1}{2}$ " of your unit total of 96". This would mean that your clear opening per shelf would be between 1.9" and 2.45". Is this enough?

Yes, this is sufficient – the shelves are to be adjustable and allow for flexibility within other pull-out shelving units. If museum staff need to remove one drawer from the unit, they should be able to do so and place it in another unit comparable in size.

Question 16 – On page 26 under Drawer Units (section6), you indicate 3" drawers. Is this 3" clear opening in the drawers?

Drawer Units are the same as RT9 above but with drawer bottoms and extending the entire height of the unit. Three (3") clear opening in drawers is sufficient. Again, these drawers should be designed to be adjustable. If staff need to remove one from a unit, they should be able to do so and place it in another unit comparable in size.

Question 17 – On page 27 under Carriages (section 7.A), you indicate the depth of row A to be 48". Under the next section (Shelving Units, section 8) you indicate the depth of the single cantilever units to be 48" and then 96" for the double? Please clarify.

Depth for Row A – single sided is 48"; double sided is 96". The first Cantilever in Row A is single sided (48") which would require a carriage wide enough to fit a 48" wide unit. The second Cantilever in Row A is double sided (96"); 48" on each side; which would require a carriage wide enough to fit a double sided Cantilever unit. The remaining units in Row A are only the carriages (units 4-6) capable of storing large bulky artifacts or 48" deep Wide-Span shelving units on carriages.

Question 18 - Do you want the single cantilever section to be mobile? B) Do you want to be able to close down and lock each section of shelving (A,B,C)?

All carriages are required to be mobile except for the last unit in Row A, B, and C. Yes, each Row should have the capability of being closed together and locked down. See Page 13, F.2, Safety Features and Page 21, G. Accessories, Item 4.

Question 19 - On page 27 under Carriages (section 7.B), you indicate the depth of the ranges in section B to be 60". Under the next section in the grid (section 8), you indicate the carriages to be 30"D. Please clarify.

See Question 17 above. The first carriage in Row B is single-sided and 30" deep which would require a carriage to hold a 30" deep unit. All additional carriages in Row B are double sided which would require the carriages to hold two (2) 30" deep units, back-to-back.

Question 20 - You have a description of Pull-out Shelving Units (POS4) on page 26. You are asking for 4 of those units in the grid on page 28. I do not see any of them indicated in the drawing. Please clarify.

The Pull-out Shelving Units (POS4) will be placed on the carriages in Row B – where we need them. All units should be designed to insert easily in any of the 4-post shelving units comparable in size. They need to be 'interchangeable'.

Question 21 – On the drawing on page 33 you indicate 3 ranges without shelving units. A) Please detail what exactly we are suppose to include on these ranges (end panels, handles, carriages). B) If we are to include carriages, please clarify the width of the carriages?

In Row A, the three non-shelving units, identified with an X, are to have the carriages with end panels with handles in the aisle. The depth of the carriages is the standard for this row at four (4) feet (48 inches) deep. These three units will hold extremely large artifacts.

Question 22 – On page 21 under Accessories (section G), you indicate an optional mechanical sweep and safety stop. I did not see a place on the pricing form to provide this option. Please clarify.

See Question/Answer 2 above.

Question 23 – On page 21 under Decking(floor)/Ramp (section B.2), you indicate steel decking with anti-slip protectant. Just below under section B.4, you state that floor covering is to be installed and supplied under this contract. A) Do you want floor covering over top of steel decking that has anti-slip protectant? B) If so, what type of floor covering?

Page 19, Section B.2, ramp and decking will be constructed and finished with the same material – heavy cold rolled steel with anti-slip protectant. Manufacturer is required to provide details on process and materials used. Materials used are to be low in off-gassing.

Question 24 – On Page 11 2.A.1, Page 14 5.2.C, Page 22 1.5 – all reference structural capability, or seismic compliance. The mobile vendor can confirm rail line loads. A) Please confirm who is responsible for the floor's ability to support the loads? B) Are structural calculations required?

The Vendor is required to ensure installation of rails, tracks, carriages, and shelving and that they are checked and rechecked for integrity of position and levelness and anchoring into structural concrete slab. As stated in Section 4, MANUFACTURED COMPONENTS, Item A.2, Rails will be designed to be attached on top of concrete floor and allow for adjustment so rails can be leveled over an uneven floor. If this process requires structural calculations, the Manufacturer is required to do so.

Question 25 – On Page 21 4.G.4 – Please confirm location and quantities of carriage mount locks.

See Question/Answer 5 above.

Question 26 – On Page 25 3.E.6.a. 2 and 3 – Specifications appear to be standard 4-post shelving specifications, but wide span is requested with shelf lengths much longer than standard 4-post shelving. Please clarify.

See Question/Answer 4 above.

Question 27 - RFQ page 3 -- Can you provide a list of the current prevailing wage rates that are applicable for this project?

Questions regarding current prevailing wage rates should be directed to Purchasing.

Question 28 - RFQ page 11, section 2.B.1 - Is the storage system supplier responsible for any analysis, engineering, or modifications to the existing floor?

See Question/Answer 24 above

Question 29 - RFQ page 11, section 2.B.2 - Is the storage system supplier responsible for supplying and/or installing the finish floor covering? If so, please provide the specifications.

See Question/Answer 23 above

Question 30 – RFQ page 11, section 2.C.1 & 2 - Can you provide a scale or dimensioned drawing of the Collections Area to determine the area and volume of concrete required?

Manufacturer is required to determine. area and volume required. Floor plan attached.
NOTE: Anywhere there is a floor conduit access panel (see attached Image QA1/floor plan specifying location, Vendor is required to maintain accessibility for the Owner.

Question 31 – RFQ page 13, section 4.C - Can you provide additional details of the steel decking, such as required thickness and type of steel? What type of finish and/or sealant is required? What is the desired deflection specification? Is steel decking the only acceptable decking material?

Decking is required to be made of heavy cold rolled steel with anti-slip protectant, capable of holding load capacities of 1,000 lbs. per square foot. It is the responsibility of the Manufacturer to provide details on process and materials used. The finish requires an anti-slip protectant. The desired deflection specification should be determined based on load requirements. Steel decking is preferred; any alternative decking material proposed cannot be susceptible to water absorption. See also page 15, J & K.

Question 32 – RFQ page 13, section 5.A.1 & 2 - Can you provide additional details on these section? What do "Row A, B, & C" refer to, and how do the terms relate to the the plan view (page 33) in the bid?

In reference to the floor layout, page 33,(top to bottom or left to right depending on orientation view). Row A is the top row (left) consisting of three (3) Cantilever units – one single-sided and one double-sided. The next three marked X are carriages only , with no shelving but finished carriages that will provide storage for large/bulky artifacts. The remaining section, marked W, are for Wide-Span shelving. The second row (middle) is Row B and consists of 4-Post Shelving (4P), Drawer Units (D), Garment Units (G), and Rolled Textile Units (RT). Row C is the row at the bottom of the floor layout marked Art Rack.

Question 33 – RFQ page 14, section 5.C - Is the storage system supplier responsible for seismic analysis, engineering, or modifications to the existing floor? If so, please describe the extent of responsibility, as seismic compliance is quite complicated.

See Question/Answer 24 above.

Question 34 – RFQ page 14, section 6.B.4 - There are hatches in the floor, possibly for underground conduit, plumbing, or piping. Are any details available, as this could interfere with attachment of rails, decking, etc.?

See attached Image QA1 and Question/Answer 30 above.

Question 35 – RFQ page 18, section 4.A.1 - Can you please provide additional details on this section? What do "Row A, B, & C" refer to, and how are the terms related to the plan views (page 33) in the bid?

See Question/Answer 32 above. Row A refers to the row for Cantilever, non shelving carriages, and Wide Span Shelving units. Row B refers to the middle row for 4 Post Shelving units, Drawer units, Garment units, and Rolled Textile units. Row C is the Art Rack.

Question 36 – RFQ page 19, section 4.B.4 - What is the specification for the finished floor covering?

See Question/Answer 23,31, and Section 4.B.2

Question 37 – RFQ page 19, section 4.B.5 - Can you provide specifications for the primer and anti-slip protectant? Is the anti-slip protectant also the finished floor covering?

See Question/Answer 23,31, and Section 4.B.2

Question 38 – RFQ page 19, section 4.B.6 - Is fire retardant treated floor/ramp material required for this project?

All proposed material must meet fire code. See Question/Answer 23 and 31 and Section 6. J and K on page 15.

Question 39 – RFQ page 21, section 4.G.1 to 5 - Can you indicate which accessories, if any, are required and where?

All except Item 5 – omitted, listed on page 21. See Question/Answer 2 above.

Question 40 – RFQ page 33, Can you provide general details of each grouping of movable shelving on the plan, including the overall rail length, carriage depth, and number of carriages per grouping, in order to clarify the information provided on pages 23 through 33.

General Details can be found in Section 3, PERFORMANCE AND INSTALLATION REQUIREMENTS beginning on page 23-29. Overall rail length can be found on page 13, Section 5.a.2, PERFORMANCE REQUIREMENTS. Carriage depth – See Question/Answer 11,12,17,19,21. Carriage information can be found on page 27-28, under Section 3.E.7 and 8, Carriages and Shelving Unit with Table.

Question 41 – In addition to the previous questions, would you please specify the load capacity requirements for each type of shelving?

Unless otherwise stated in Section 3.E, PERFORMANCE AND INSTALLATION REQUIREMENTS, beginning on page 24, (1) Cantilever, (2) Wide Span, (3) Garment, (4) Rolled Textile, (5) Pull-

out Shelving, and (6) Drawer Units, load capacity requirements for shelving and shelving units is (at a minimum) 1,000 lbs. per square foot.

Image Q/A1 (Floor Conduit Access Panel) Total in CR1 – approx 2



SIGN IN SHEET

Request for Proposal No. DCH12107

PLEASE PRINT

Date: 5/22/12

*** PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD**

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>PA BUSINESS PARTNERS</u>	<u>114 POWELL ST</u>	PHONE <u>412-849-5496</u>
Rep: <u>DAVID CAPRASA</u>	<u>E. PITTSBURGH, PA 15112</u>	TOLL FREE
Email Address: <u>dcaprasa@pabusinesspartners.com</u>		FAX <u>412-351-0138</u>
Company: <u>Borroughs Corporation</u>	<u>3002 N. Burdick St</u>	PHONE <u>248-431-3602</u>
Rep: <u>Craig Thomas</u>	<u>Kalamazoo, MI 49004</u>	TOLL FREE
Email Address: <u>CThomas@borroughs.com</u>		FAX <u>248-461-1313</u>
Company: <u>AJ-Allegheny Systems</u>	<u>5036A Washington St. W</u>	PHONE (304) 546-0609 ⁵⁴⁶⁻⁰⁶⁰⁹
Rep: <u>Kenny Saul</u>	<u>Charleston, WV 25313</u>	TOLL FREE <u>877-855-5255</u>
Email Address: <u>Kenny@ajwo.net</u>		FAX (304) <u>769-0203</u>
Company: _____	_____	PHONE TOLL FREE
Rep: _____	_____	FAX
Email Address: _____	_____	
Company: _____	_____	PHONE TOLL FREE
Rep: _____	_____	FAX
Email Address: _____	_____	

SIGN IN SHEET

Request for Proposal No. DCH12107

PLEASE PRINT

Date: 5/22/12

* PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD

TELEPHONE & FAX NUMBERS

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>Capital Business Interiors</u> Rep: <u>Kathy Levitan</u> Email Address: kklevitan <u>kklevitan@entelos.net</u>	<u>711 Indiana Ave</u> <u>Charleston WV</u> <u>25304</u>	PHONE <u>304-343-7551</u> TOLL FREE FAX <u>304-346-3350</u>
Company: <u>Patterson Pope</u> Rep: <u>Kirk Martin</u> Email Address: <u>kmartin@pattersonpoppe.com</u>	<u>115 Brand Ave</u> <u>Salem, VA 24153</u>	PHONE <u>540-389-7726</u> TOLL FREE FAX <u>540-389-9702</u>
Company: <u>Patterson Pope</u> Rep: <u>David Parr</u> Email Address: <u>dparr@pattersonpoppe.com</u>	<u>3001 North Graham St.</u> <u>Charlotte, N.C. 28206</u>	PHONE <u>704-⁷¹⁶716-3959</u> TOLL FREE FAX
Company: <u>G+R Masonry, Inc.</u> Rep: <u>Matt McDaniel</u> Email Address: <u>gandrestimator11@gmail.com</u>	<u>808 B STREET, 2ND FLOOR</u> <u>ST. ALBANS, WV 25177</u>	PHONE <u>304 722 5256</u> TOLL FREE <u>CELL 304 545 0080</u> FAX <u>304 201 1112</u>
Company: _____ Rep: _____ Email Address: _____	_____ _____ _____	PHONE _____ TOLL FREE _____ FAX _____