

MAPPING NOTES

1. ALL UNDERGROUND UTILITIES AS SHOWN HEREON ARE APPROXIMATE LOCATIONS AND ARE BASED ON UTILITY COMPANY MARKINGS, EXISTING STRUCTURE LOCATIONS AND PLAN INFORMATION PROVIDED BY OTHERS. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY LOCATIONS PRIOR TO CONSTRUCTION.
2. TOPOGRAPHIC MAPPING COMPILED FROM AERIAL SURVEY PERFORMED BY GEO ONE, INC. OF REYNOLDSBURG, OH ON NOVEMBER 19, 2010. SURVEY CONTROL AND TOPOGRAPHIC DATA RANDOMLY CHECKED FOR ACCURACY BY CAPITOL ENGINEERING, INC. BY FIELD SURVEY.
3. PROPERTY SURVEY AS SHOWN ON THE PLAT TITLED "PLAT SURVEY FOR THE STATE OF WEST VIRGINIA, ADJUTANT GENERAL'S DEPARTMENT MOOREFIELD DISTRICT, HARDY COUNTY, WEST VIRGINIA" DATED 7-13-10. PERFORMED BY MAYHEW SURVEYING INC. OF ROMNEY, WV.

GENERAL NOTES

1. DURABLE ROCK FILL IS REQUIRED FOR MANY OF THE FILL AREAS. SEE NOTES ON PLAN FOR MORE INFORMATION.
2. EXISTING SOILS MUST BE UNDERCUT TO ROCK IN ALL AREAS REQUIRING DURABLE ROCK FILL. (REMOVE SOIL OVERBURDEN)
3. ALL FILL MUST BE BENCHED INTO ROCK AS FILL PROGRESSES UP THE SLOPES. (REMOVE SOIL OVERBURDEN)
4. READINESS CENTER BUILDING SHALL BE UNDERCUT 18" BELOW FINISH FLOOR ELEVATION. BACKFILL SHALL CONSIST OF CRUSHED AGGREGATE UNDER FLOOR SLABS AND CONTROLLED LOW STRENGTH MATERIAL UNDER FOUNDATIONS.

GRADING NOTES

- 1 12" YARD DRAIN
- 2 TYPE B INLET
- 3 JUNCTION BOX
- 4 CONCRETE HEADWALL
- 5 12" TRENCH DRAIN
- 6 FREE DRAINING BASE TRENCH
- 7 TYPE 1 DITCH
- 8 TYPE 2 DITCH
- 9 TYPE 3 DITCH
- 10 TYPE 4 DITCH
- 11 DRAIN BASIN
- 12 TYPE 'G' INLET
- 13 MODIFIED JUNCTION BOX

1. WHERE SMALL PIPES TIE INTO LARGE PIPES OUTSIDE OF AN INLET OR JUNCTION, THE SMALL PIPE SHALL BE INSTALLED IN THE UPPER HALF OF THE LARGER PIPE. THE OPENINGS AROUND THE SMALLER PIPE SHALL BE SEALED WITH NON-SHRINK GROUT OR APPROVED MATERIAL.
2. SLOPE LAWN TO YARD DRAINS

LEGEND

→ SLOPE INDICATION ARROW OR GATE OPENING DIRECTION (FOR REFERENCE ONLY)

ADDED STORMWATER STRUCTURE SCHEDULE



STORMWATER STRUCTURE SCHEDULE (ALTERNATE BID)

NO.	RIM EL.	INVERT IN	INVERT IN	INVERT IN	INVERT OUT
A2-2	1059.0	18" 1050.9	15" 1050.9	4" 1052.0	18" 1050.8
A2-2A	1058.5	15" 1053.2	4" 1053.2		15" 1053.1
A2-3	1059.5	18" 1053.1	8" 1053.1	6" 1053.1	18" 1053.0
A2-4	1059.5	18" 1053.5	8" 1053.4		18" 1053.3

STORMWATER STRUCTURE SCHEDULE (BASE BID)

NO.	RIM EL.	INVERT IN	INVERT IN	INVERT IN	INVERT OUT
JB C-1	1055.0	36" 1016.0			36" 1015.9

- STORE ANY SECTIONS NOT NEEDED ON COMPLETED FILL

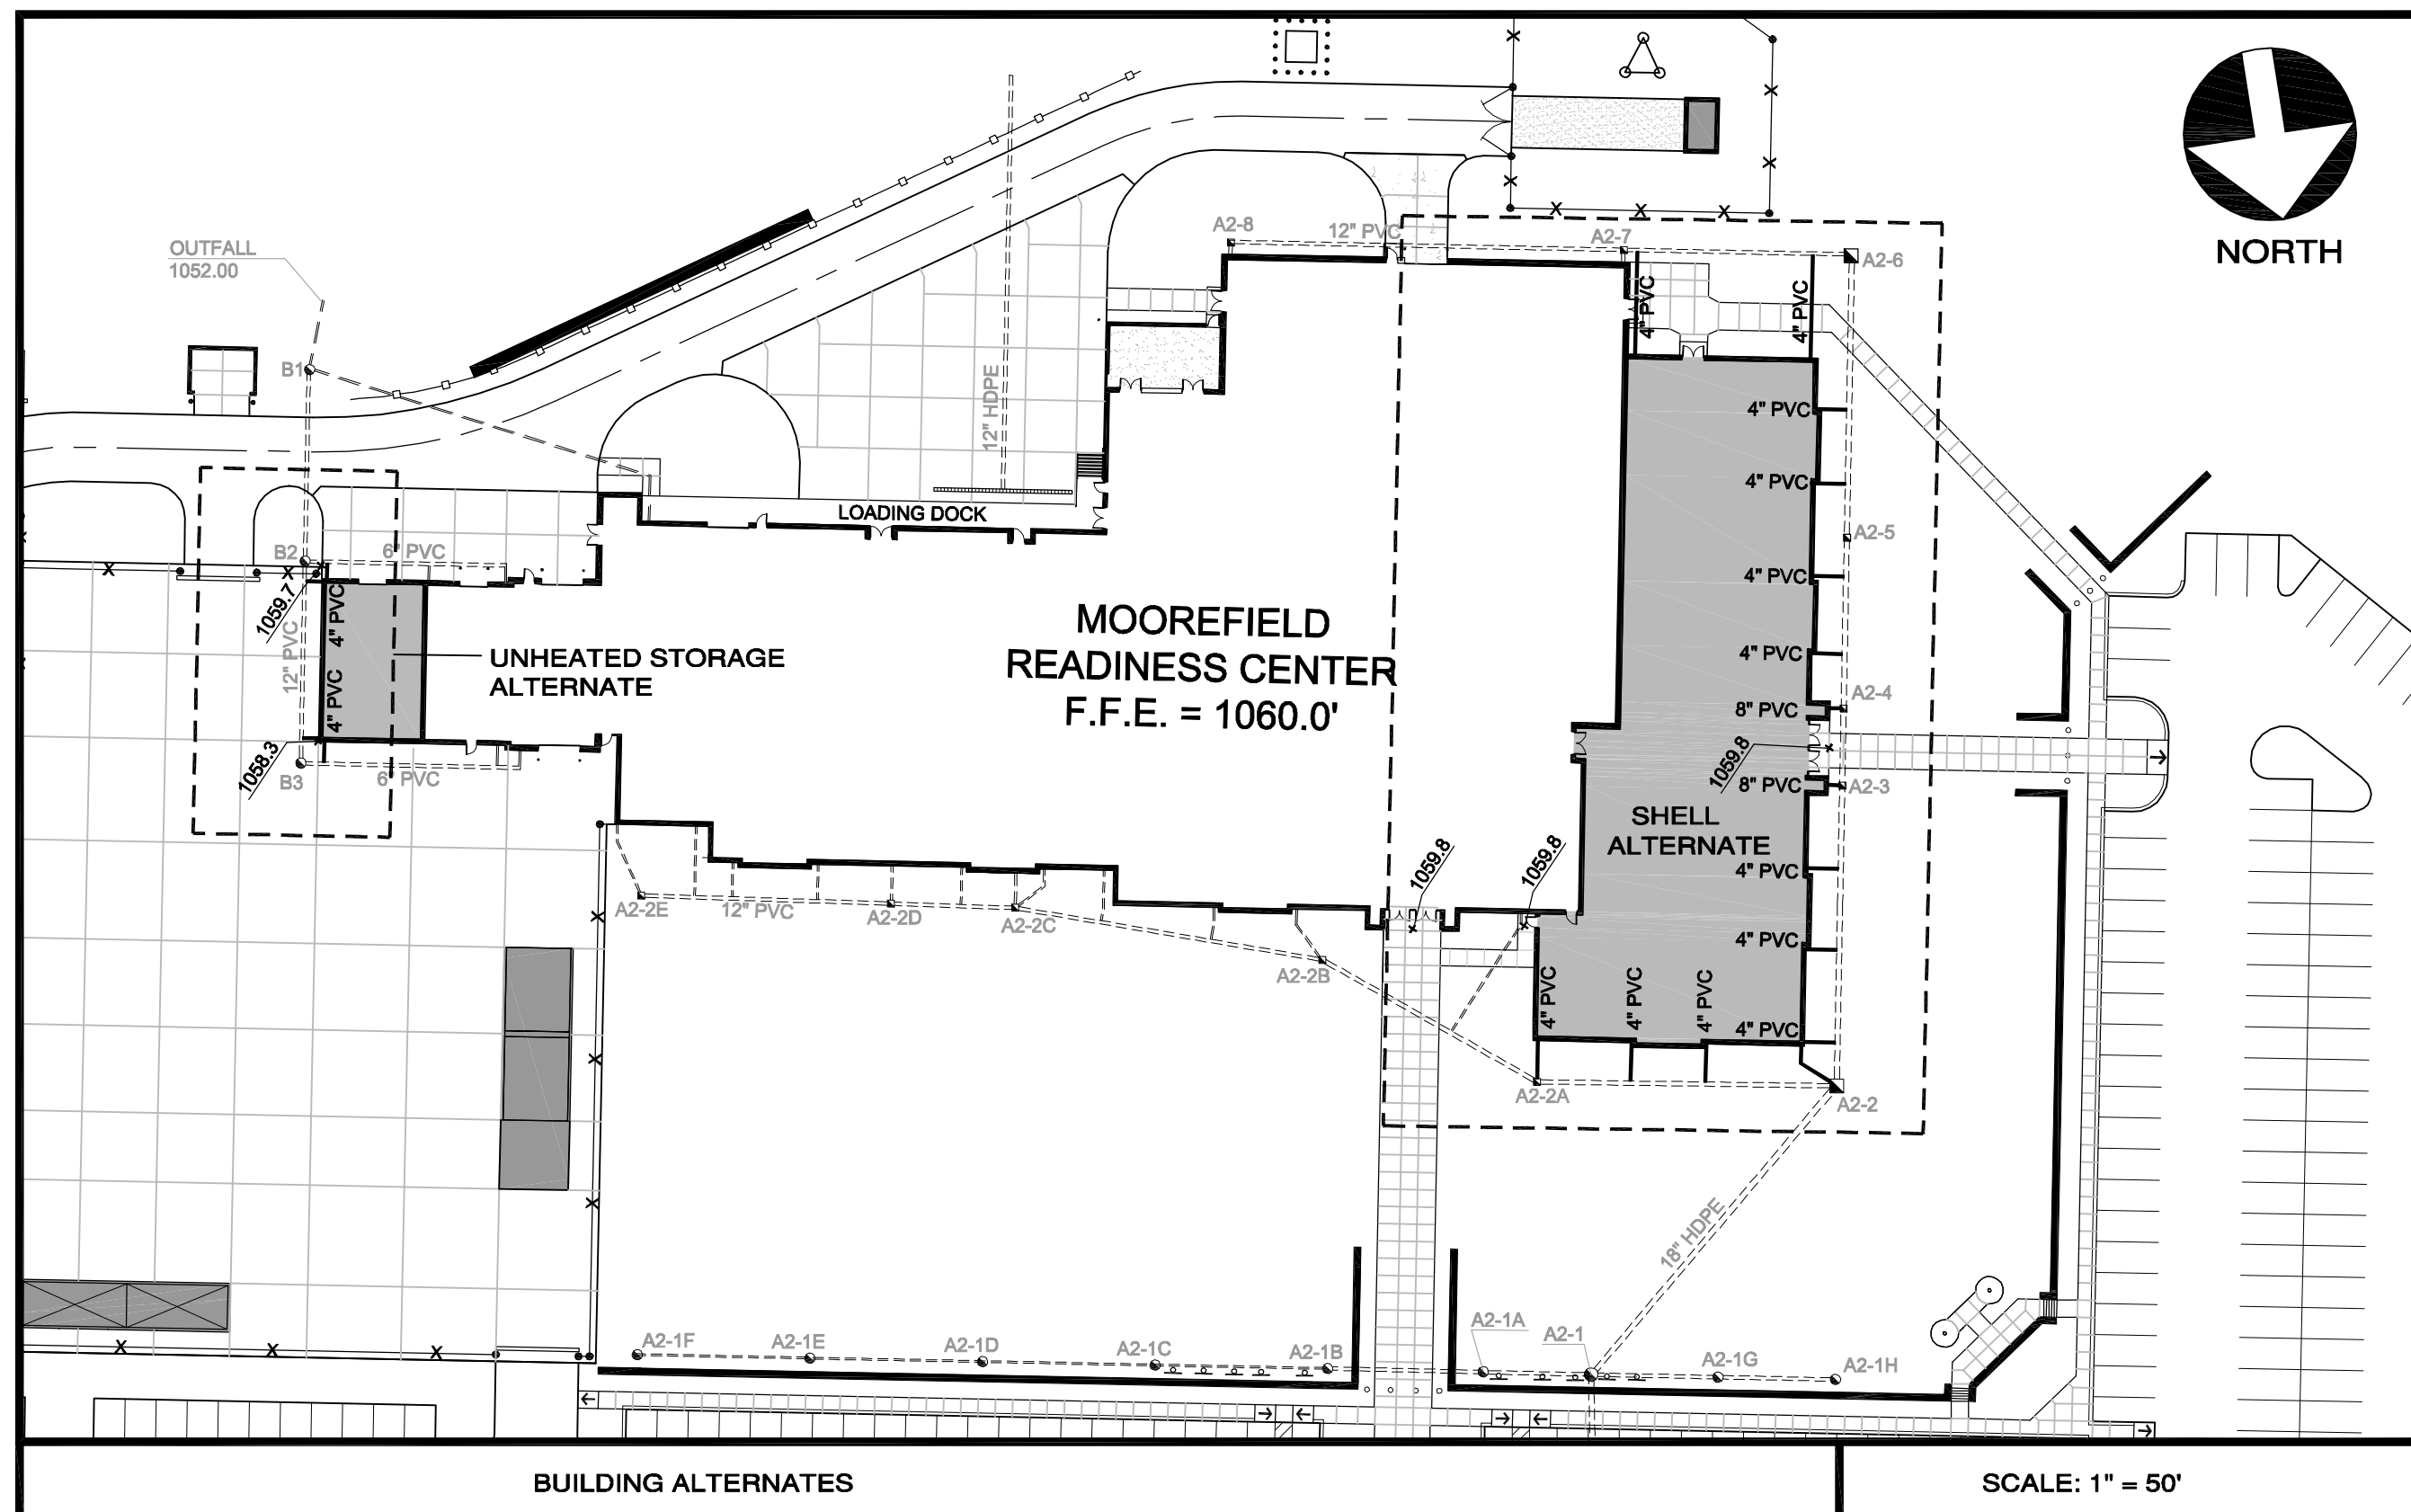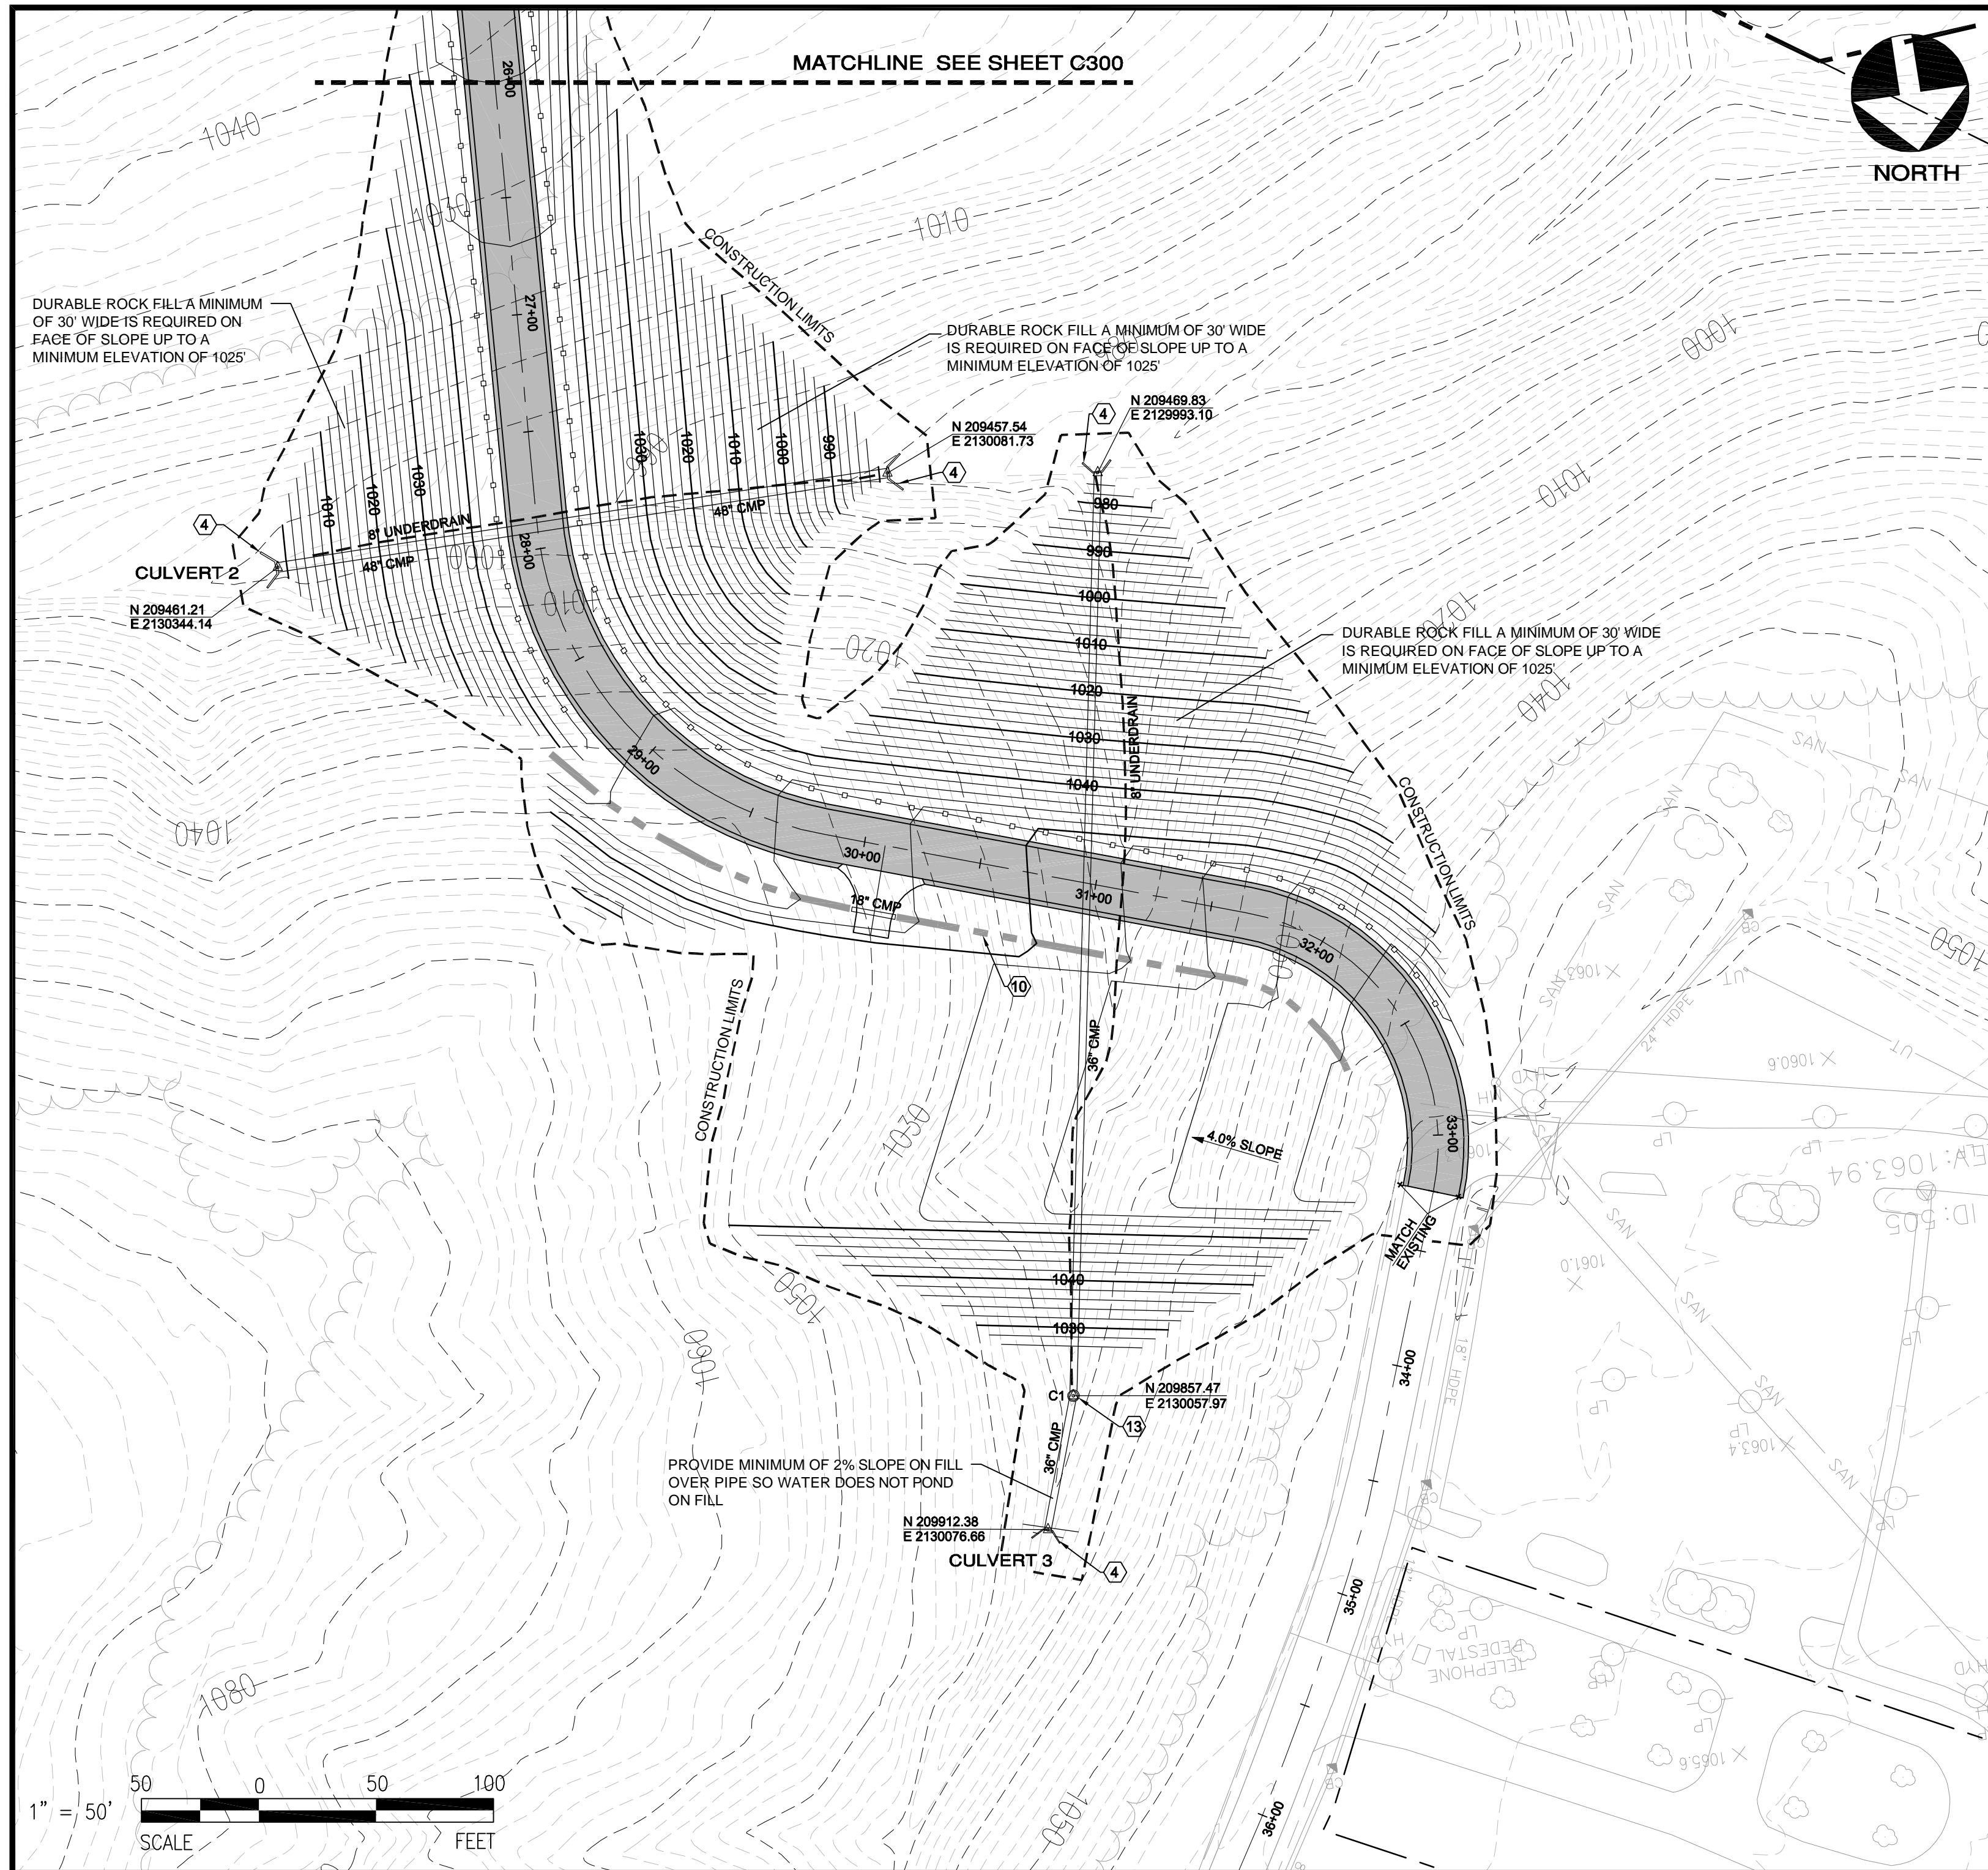

GENERAL CONTRACTOR & ALL SUB-CONTRACTORS SHALL FIELD VERIFY ALL DIMENSIONS AND FIELD CONDITIONS BEFORE EXCAVING ANY WORK. STRUCTURE IS DESIGNED TO BE SELF-SUPPORTING AND COMPLETE. GENERAL CONTRACTOR AND ERECTOR TO DETERMINE TEMPORARY BRACING REQUIREMENTS AS NECESSARY. GENERAL CONTRACTOR & SUB-CONTRACTORS ARE SOLELY RESPONSIBLE FOR CONSTRUCTION SCHEDULE AND SEQUENCE.