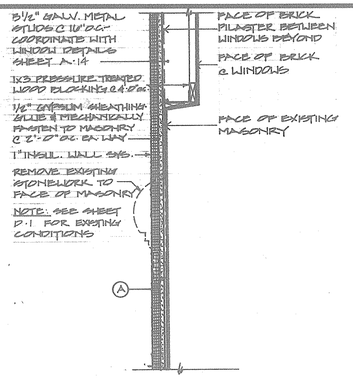

EXTERIOR WALL DETAIL

1½"=1'-0" SECTION VIEW (1 / A9)

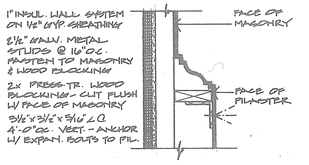

EXTERIOR WALL DETAIL

1½"=1'-0" SECTION VIEW (2 / A9)

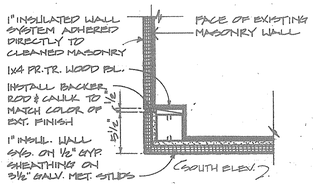

EXPAN. JOINT PLAN VIEW

1½"=1'-0" (3 / A9)

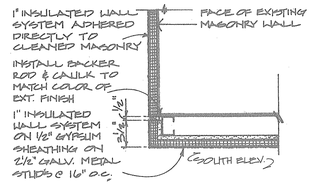

EXPAN. JOINT PLAN VIEW

1½"=1'-0" (4 / A9)

INSULATED WALL SYSTEM GENERAL NOTES

CONSULT WITH THE ARCHITECT FOR COLOR AND DETAILING AT ALL "BLIND" ELEVATIONS (INSIDE RETURNS, ETC.) WHICH ARE NOT SHOWN ON THE ELEVATION DRAWINGS OR DETAILS PRIOR TO INSTALLING THE INSULATED WALL SYSTEM.

ALL WOOD FRAMING AND BLOCKING USED ON THE EXTERIOR WALLS SHALL BE PRESSURE TREATED.

ALL METAL FRAMING USED ON THE EXTERIOR WALLS SHALL BE GALVANIZED AND SHALL BE A MINIMUM OF 20 GAUGE STEEL.

COLOR KEY - AS APPROVED BY THE ARCHITECT

- (A) LIGHT BEIGE
- (B) BROWN
- (C) MAGENTA

ALL INSULATED WALL SYSTEM FROM ELEVATION 110'-0" DOWN TO GRADE SHALL RECEIVE AN EXTRA LAYER OF HEAVY-DUTY REINFORCING MESH ('DRYVIT-PANZER MESH' OR EQUAL)

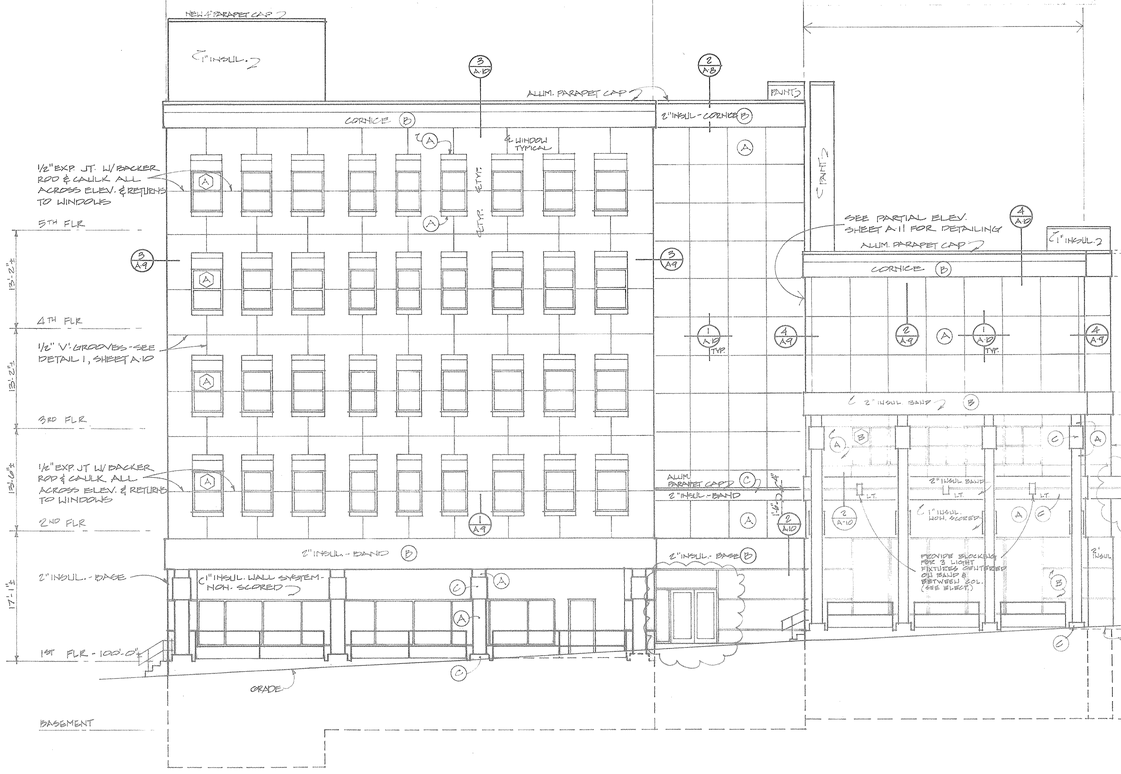
1" INSULATED WALL SYSTEM ON 1/2" GYPSUM SHEATHING ON 3½" GALVANIZED METAL STUDS AT 16" O.C. OR AS REQUIRED. MOUNT METAL STUDS INSIDE RECESS OF EXISTING MASONRY PILASTERS ON 1 x 3 WOOD BLOCKING AT 6'-0" O.C.; GYPSUM SHEATHING TO "BRIDGE" ACROSS FACE OF PILASTERS. GLUE AND MECHANICALLY FASTEN GYPSUM SHEATHING AT AREAS ABOVE AND BELOW WINDOW PILASTERS AS DETAILED.
1" INSULATED WALL SYSTEM ADHERED DIRECTLY TO CLEANED MASONRY WALL. INSTALL AS PER MANUFACTURER'S RECOMMENDATIONS.
1" INSULATED WALL SYSTEM ON 1/2" GYPSUM SHEATHING ON 2½" GALVANIZED METAL STUDS @ 16" O.C. PROVIDE WOOD BLOCKING AS REQUIRED AT 4'-0" O.C. INSTALLED HORIZONTALLY TO SECURELY FASTEN METAL STUDS TO EXISTING MASONRY WALL.
NEW 4" ALUM. PARAPET CAP
2" INSUL.
ALUM. PARAPET CAP
2" INSUL. - CORNICE
CORNICE
WINDOW TYPICAL
1½" EXP JT. W/ BACKER ROD & CAULK ALL ACROSS ELEV. & RETURNS TO WINDOWS
5TH FLR.
4TH FLR.
1½" V' GROOVES - SEE DETAIL 1, SHEET A.10
3RD FLR.
1½" EXP JT W/ BACKER ROD & CAULK ALL ACROSS ELEV. & RETURNS TO WINDOWS
2ND FLR.
2" INSUL. - BAND
2" INSUL. - BASE
1" INSUL. WALL SYSTEM - NON-SCORED
1ST FLR. - 100'-0"
GRADE
BASEMENT
SEE PARTIAL ELEV. SHEET A.11 FOR DETAILING
EXISTING SCUPPERS TO REMAIN-INSTALL NEW ALUM. FLASHG. BOT. & SIDES OF OPENING.
2" INSUL. BAND
2" INSUL. BASE
1" INSUL. SCORED
PROVIDE BLOCKING FOR LIGHT FIXTURES - CAULK ALL AROUND - TYPICAL ALL EXTERIOR LIGHTS
MEZZANINE
1ST FLR. 104'-1"
SEE EL. PLANS FOR SOUTH.
21'8" FL.
12'-0"
6'-8"
3'-0"
8'-0"
5'-0"
4'-0"
4'-0"
9'-3"
8"
1" INSUL.
1" INSUL. - CORNICE
SCUPPER - SEE NOTE
1" INSUL. BAND
2" INSUL. - BASE
LT.
NEW ROLL-UP DOOR IN EXISTING FRAME.
5 FUTURE ELEC. CONDUITS - PROVIDE BLOCKING AS REQUIRED IN INSUL. WALL SYSTEM & CAULK ALL AROUND.
NEW STAIRS & RAILS - SEE DTL 10 / SP-1
TYP.
EQ.
EQ.
EQ