

LIGHTNING PROTECTION

- 1.) U. L. MASTER LABELS
- 2.) GROUND RESISTANCE TESTS

RECEIVED

DAYTON 513-228-7250
800-872-1657
TELEFAX NO 513-228-1508

DEC 14 1994

NITRO ELECTRIC CO.



MAXWELL
LIGHTNING PROTECTION COMPANY
621 POND STREET DAYTON, OHIO 45402

December 12, 1994

Nitro Electric Company
P.O. Box 425
Nitro, WV 25143

Attention: Bob Bradshaw

SUBJECT: Lightning Protection Master Labels No.

512839	Main Buildings
512840	Area H & I
512841	Area J
512842	Area K
512843	Area L
512844	Area M
512845	Area N
512846	Area O
512847	Area P
512848	Area R
512849	Area Q

PROJECT: Mt. Olive Correctional Complex
Mt. Olive, WV
Our Job No. 92187

Gentlemen:

Enclosed is the Master Labels for the above named project. The numbers should be recorded on the owner's yellow copy of the application.

Please have the Master Labels and our Maxwell Lightning installer's labels installed on the roof hatch or switchgear in the electrical room, so that they will be clearly visible.

Thank you for allowing us the opportunity to serve you, and if we can be of further assistance, please feel free to contact us.







Sincerely,

MAXWELL LIGHTNING PROTECTION COMPANY

Wayne S. Maxwell
Wayne S. Maxwell

/ljm

Enclosures: Master Labels
Maxwell Labels

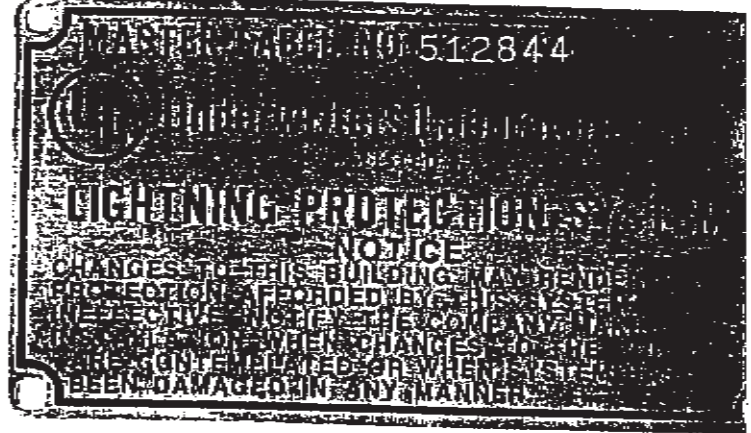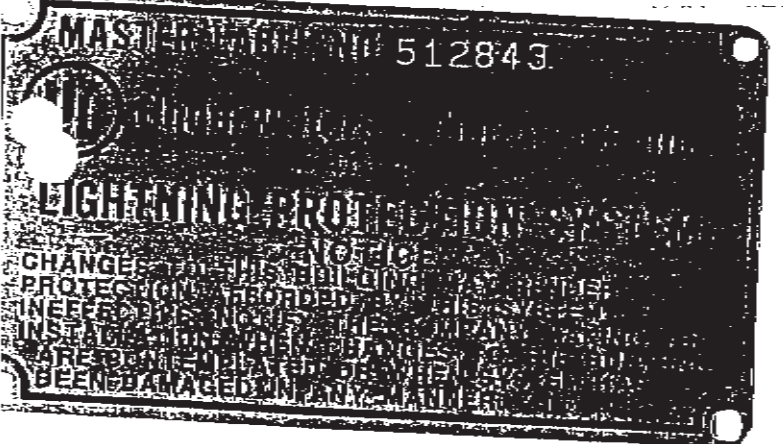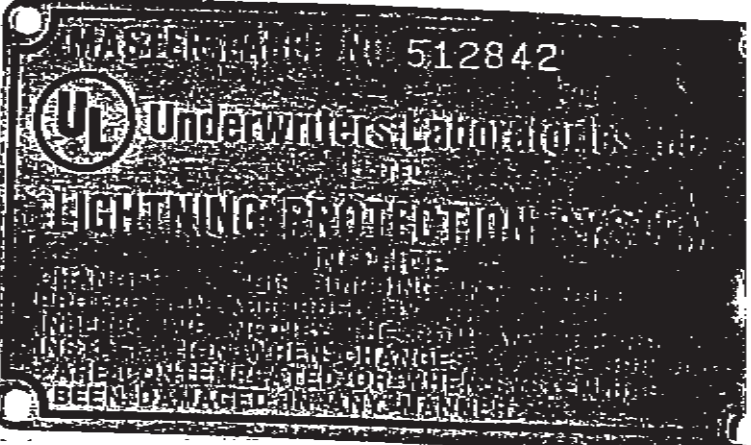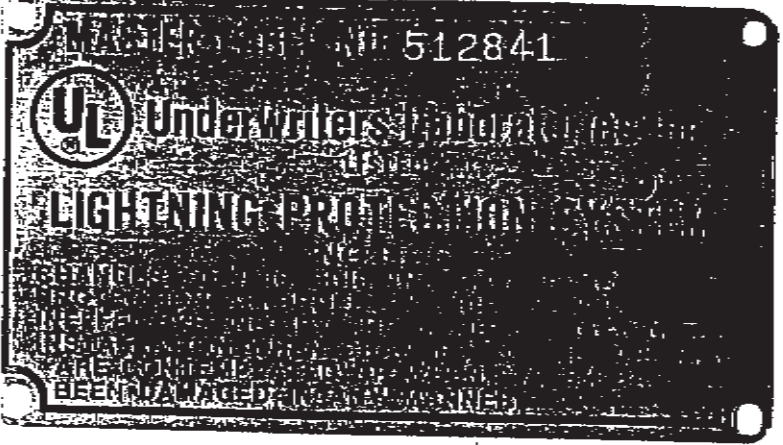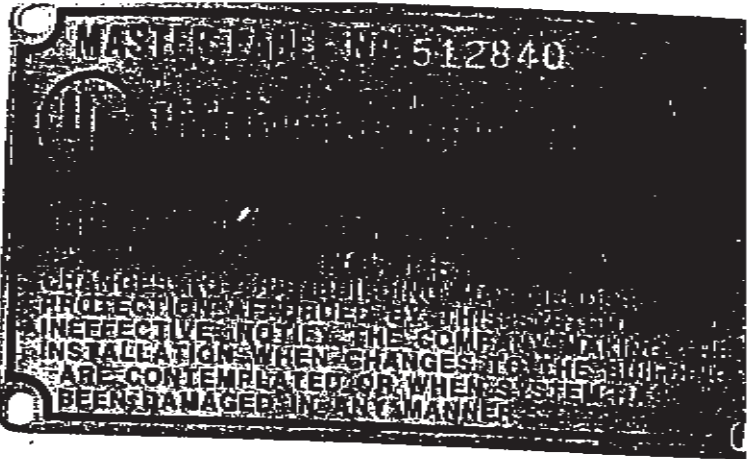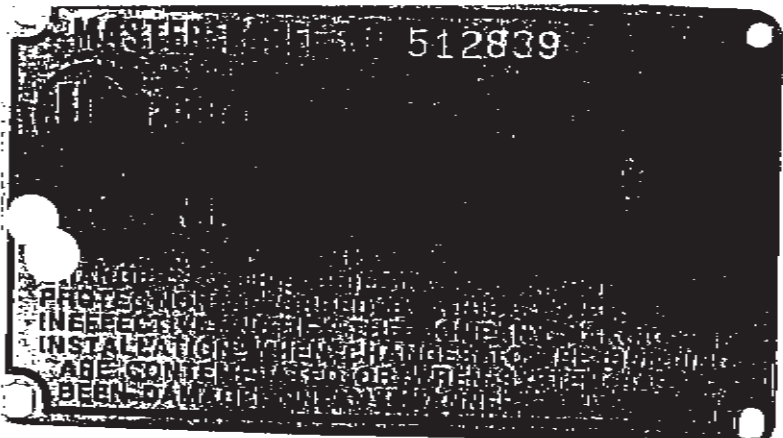

Installer W. J. ...
 This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS E24(96-3)
 for lightning protection installations to be forwarded to
 Owner ...

Address

Building	Master Label
...	No
...	No
...	No
...	No
...	No
...	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.

LIGHTNING PROTECTION

- 1.) U. L. MASTER LABELS
- 2.) GROUND RESISTANCE TESTS

RECEIVED

DAYTON 513-228-7250
800-872-1657
TELEFAX NO 513-228-1508

DEC 14 1994

NITRO ELECTRIC CO.



MAXWELL
LIGHTNING PROTECTION COMPANY
621 POND STREET DAYTON, OHIO 45402

December 12, 1994

Nitro Electric Company
P.O. Box 425
Nitro, WV 25143

Attention: Bob Bradshaw

SUBJECT: Lightning Protection Master Labels No. 512839 Main Buildings
 512840 Area H & I
 512841 Area J
 512842 Area K
 512843 Area L
 512844 Area M
 512845 Area N
 512846 Area O
 512847 Area P
 512848 Area R
 512849 Area Q

PROJECT: Mt. Olive Correctional Complex
Mt. Olive, WV
Our Job No. 92187

Gentlemen:

Enclosed is the Master Labels for the above named project. The numbers should be recorded on the owner's yellow copy of the application.

Please have the Master Labels and our Maxwell Lightning installer's labels installed on the roof hatch or switchgear in the electrical room, so that they will be clearly visible.

Thank you for allowing us the opportunity to serve you, and if we can be of further assistance, please feel free to contact us.







Sincerely,

MAXWELL LIGHTNING PROTECTION COMPANY

Wayne S. Maxwell
Wayne S. Maxwell

/ljm

Enclosures: Master Labels
Maxwell Labels

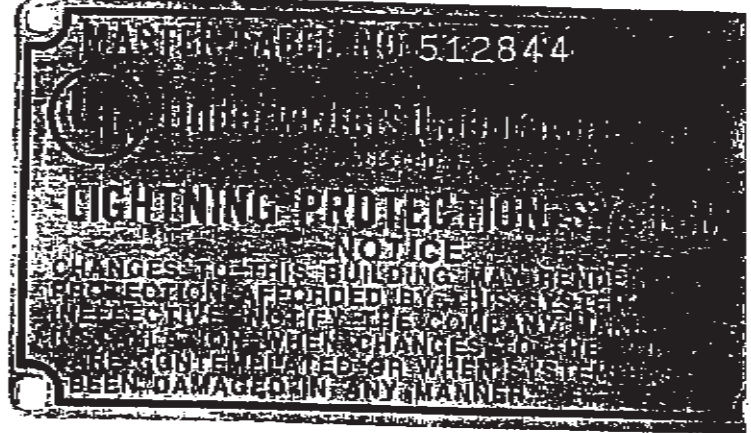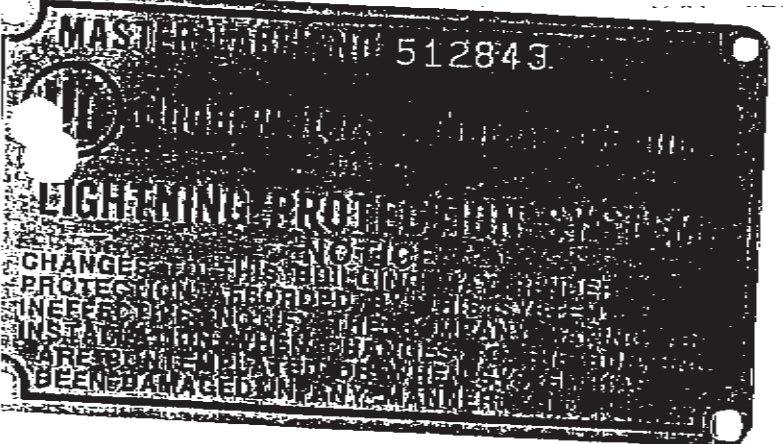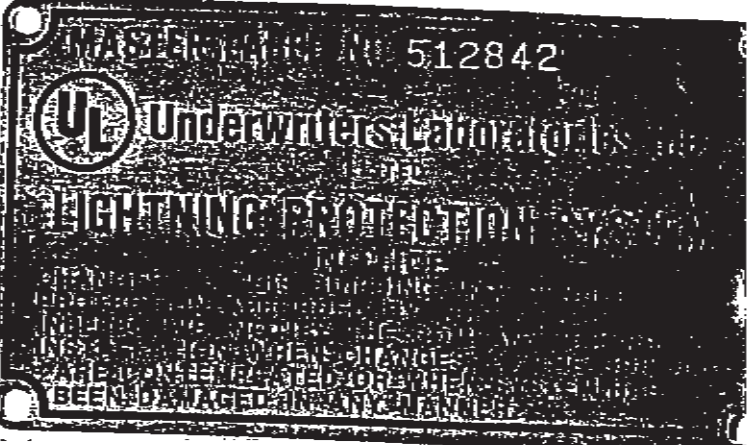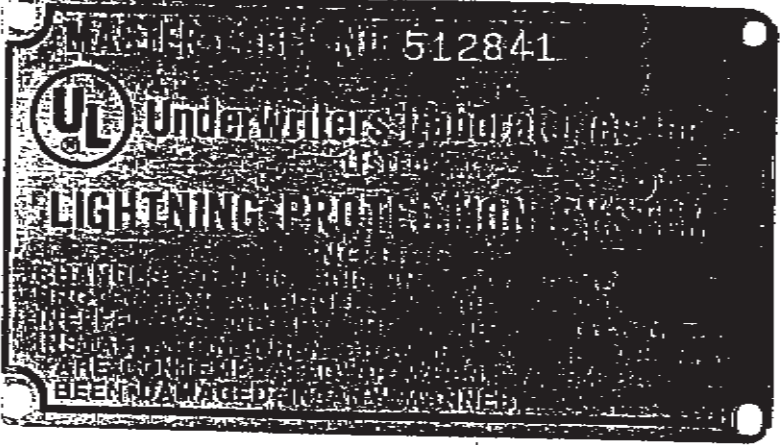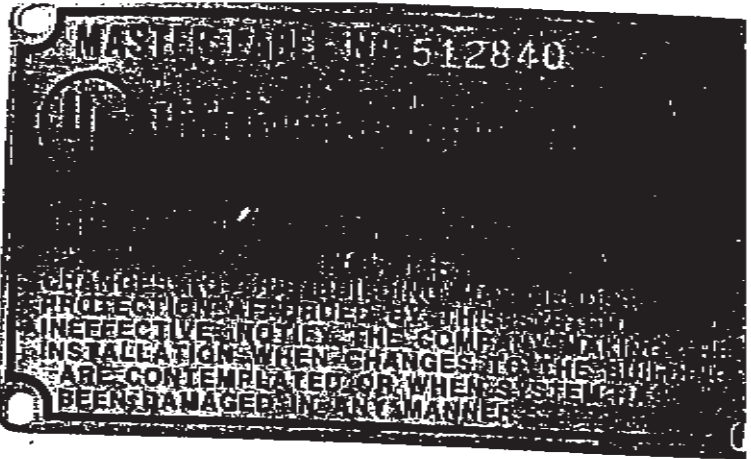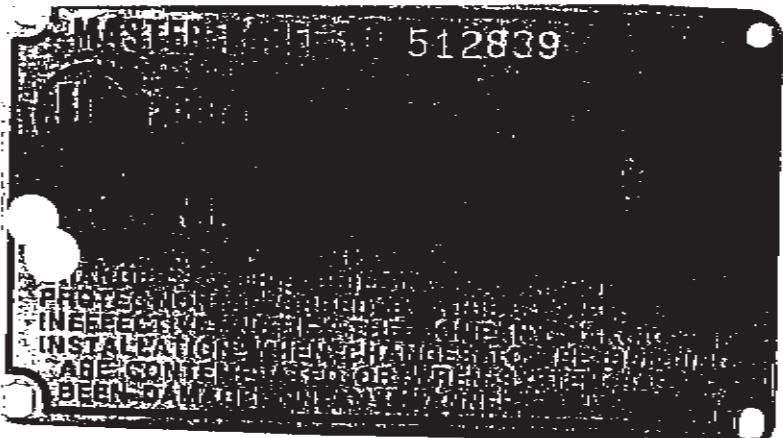





Installer W. J. ...
 This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS for lightning protection installations to be forwarded to
 Owner ...

E24(96-3)

Address

Building	Master Label
...	No
...	No
...	No
...	No
...	No
...	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.

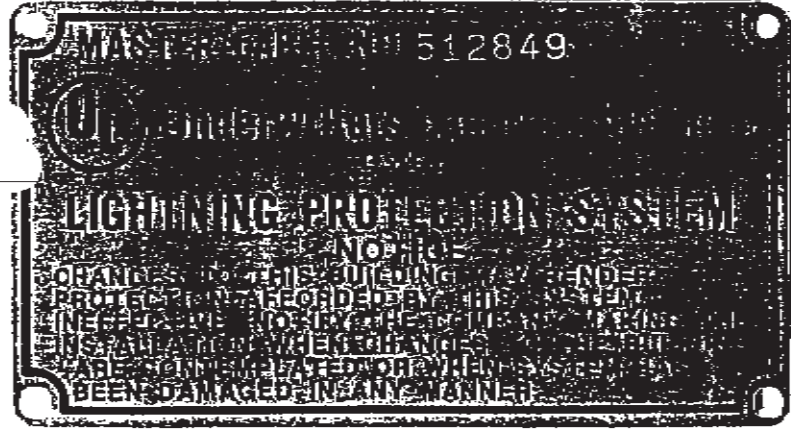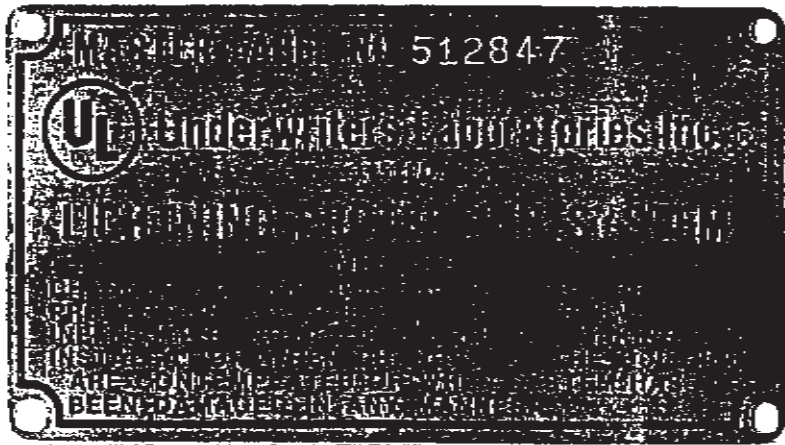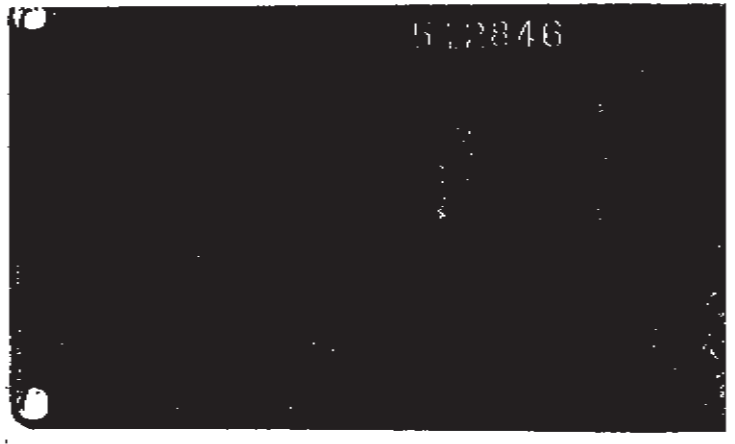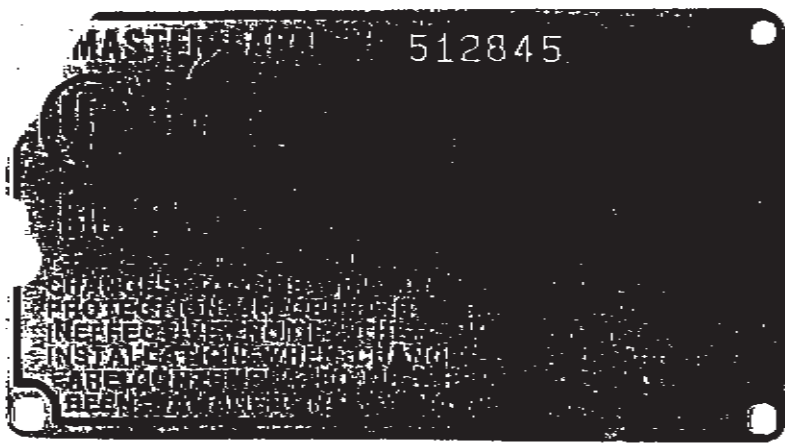

Installer W.A. W.C.
 This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS
 for lightning protection installations to be forwarded to
 Owner W.A. W.C. Construction Complex

E24(96-3)

Address

Building	Master Label
<u>11</u>	No <u>512845</u>
<u>11</u>	No <u>6</u>
<u>6</u>	No <u>7</u>
<u>1</u>	No <u>1</u>
<u>1</u>	No <u>5</u>
	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.

LIGHTNING PROTECTION

- 1.) U. L. MASTER LABELS
- 2.) GROUND RESISTANCE TESTS

RECEIVED

DAYTON 513-228-7250
800-872-1657
TELEFAX NO 513-228-1508

DEC 14 1994

NITRO ELECTRIC CO.



MAXWELL
LIGHTNING PROTECTION COMPANY
621 POND STREET DAYTON, OHIO 45402

December 12, 1994

Nitro Electric Company
P.O. Box 425
Nitro, WV 25143

Attention: Bob Bradshaw

SUBJECT: Lightning Protection Master Labels No. 512839 Main Buildings
 512840 Area H & I
 512841 Area J
 512842 Area K
 512843 Area L
 512844 Area M
 512845 Area N
 512846 Area O
 512847 Area P
 512848 Area R
 512849 Area Q

PROJECT: Mt. Olive Correctional Complex
Mt. Olive, WV
Our Job No. 92187

Gentlemen:

Enclosed is the Master Labels for the above named project. The numbers should be recorded on the owner's yellow copy of the application.

Please have the Master Labels and our Maxwell Lightning installer's labels installed on the roof hatch or switchgear in the electrical room, so that they will be clearly visible.

Thank you for allowing us the opportunity to serve you, and if we can be of further assistance, please feel free to contact us.







Sincerely,

MAXWELL LIGHTNING PROTECTION COMPANY

Wayne S. Maxwell
Wayne S. Maxwell

/ljm

Enclosures: Master Labels
Maxwell Labels

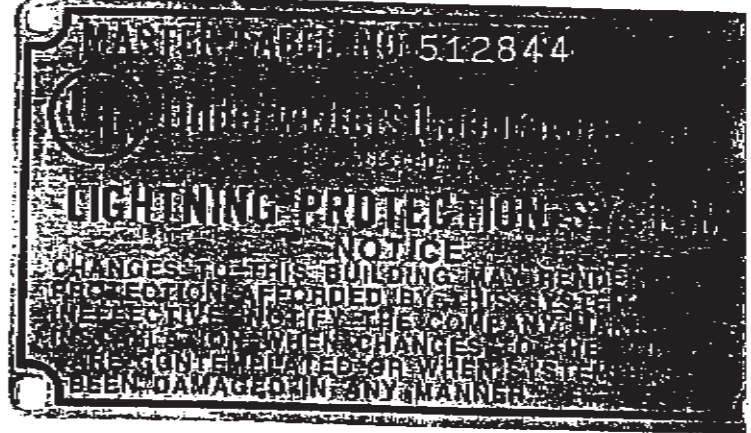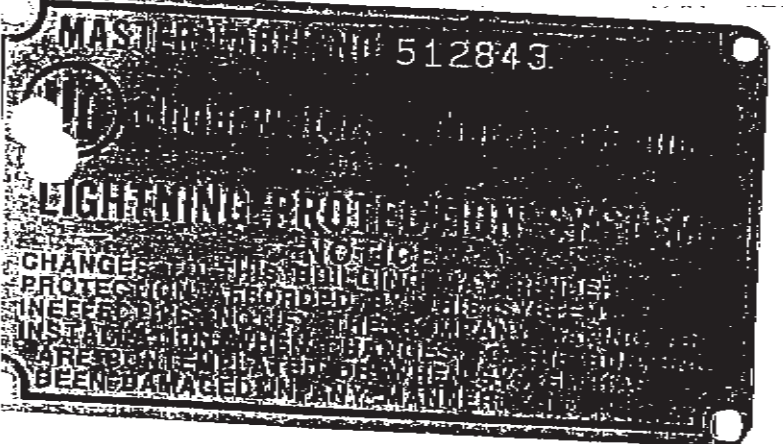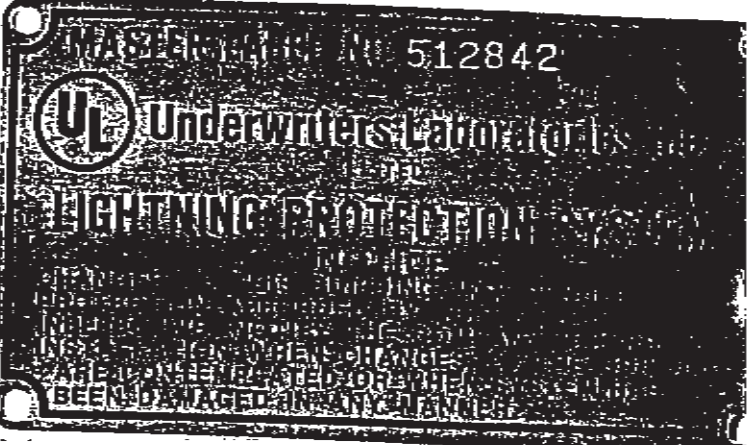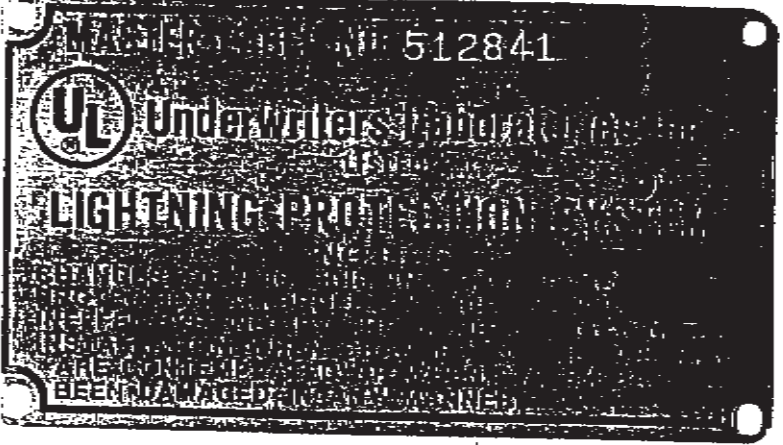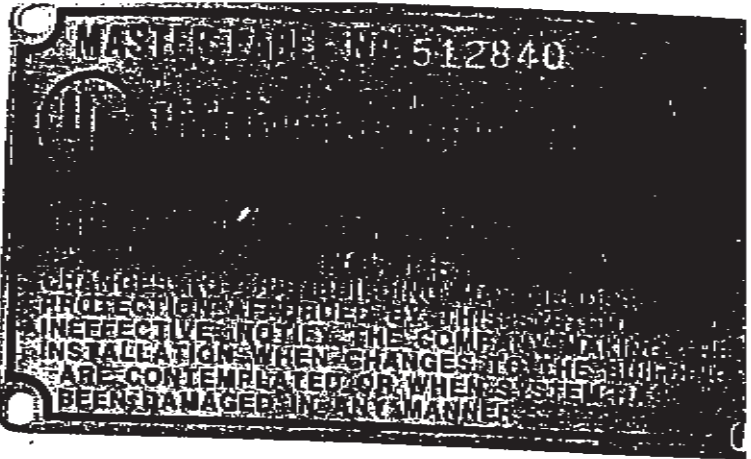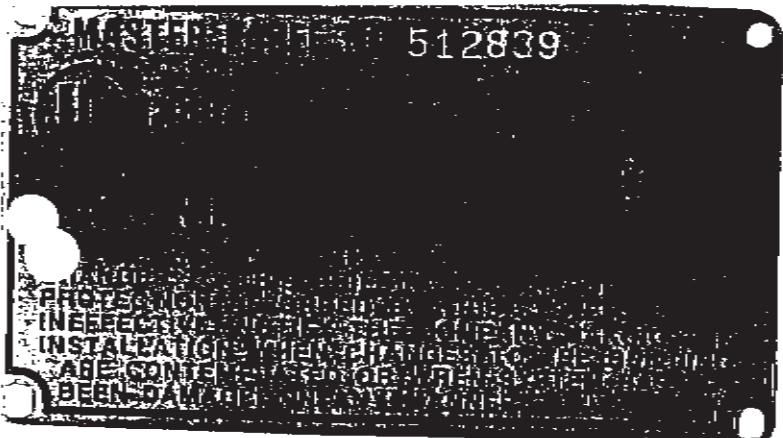

Installer W. J. ...
 This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS E24(96-3)
 for lightning protection installations to be forwarded to
 Owner ...

Address

Building	Master Label
...	No
...	No
...	No
...	No
...	No
...	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.

LIGHTNING PROTECTION

- 1.) U. L. MASTER LABELS
- 2.) GROUND RESISTANCE TESTS

RECEIVED

DAYTON 513-228-7250
800-872-1657
TELEFAX NO 513-228-1508

DEC 14 1994

NITRO ELECTRIC CO.



MAXWELL
LIGHTNING PROTECTION COMPANY
621 POND STREET DAYTON, OHIO 45402

December 12, 1994

Nitro Electric Company
P.O. Box 425
Nitro, WV 25143

Attention: Bob Bradshaw

SUBJECT: Lightning Protection Master Labels No.

512839	Main Buildings
512840	Area H & I
512841	Area J
512842	Area K
512843	Area L
512844	Area M
512845	Area N
512846	Area O
512847	Area P
512848	Area R
512849	Area Q

PROJECT: Mt. Olive Correctional Complex
Mt. Olive, WV
Our Job No. 92187

Gentlemen:

Enclosed is the Master Labels for the above named project. The numbers should be recorded on the owner's yellow copy of the application.

Please have the Master Labels and our Maxwell Lightning installer's labels installed on the roof hatch or switchgear in the electrical room, so that they will be clearly visible.

Thank you for allowing us the opportunity to serve you, and if we can be of further assistance, please feel free to contact us.







Sincerely,

MAXWELL LIGHTNING PROTECTION COMPANY

Wayne S. Maxwell
Wayne S. Maxwell

/ljm

Enclosures: Master Labels
Maxwell Labels

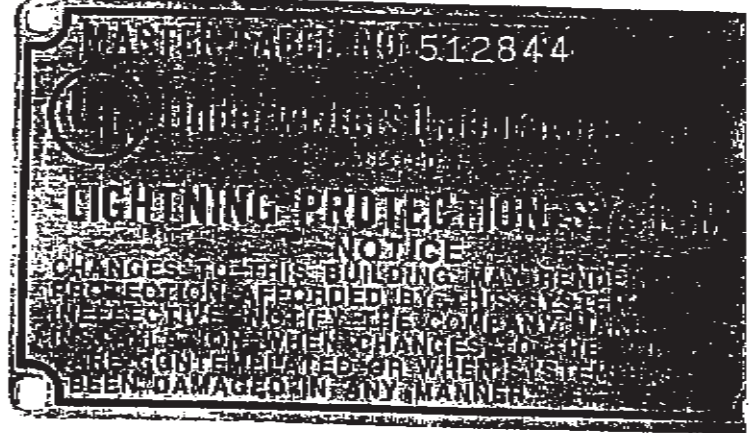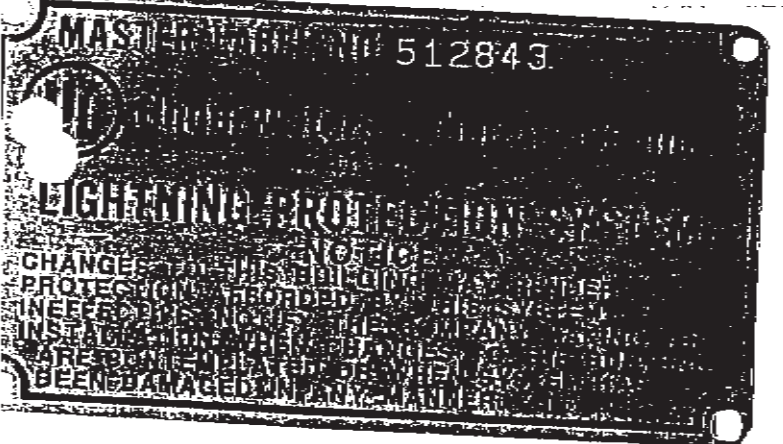
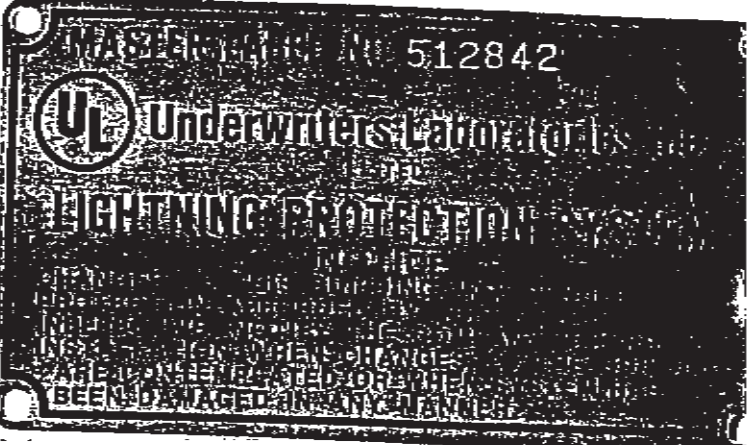
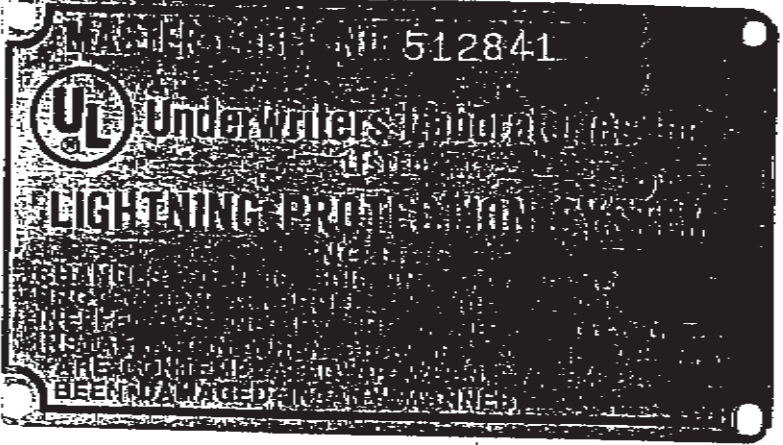
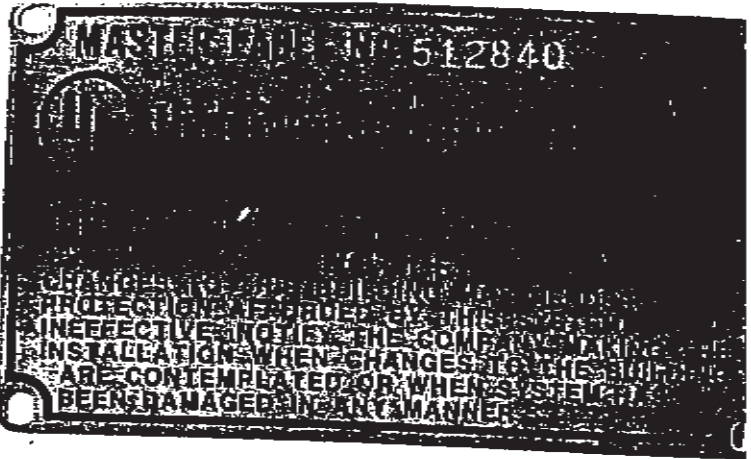
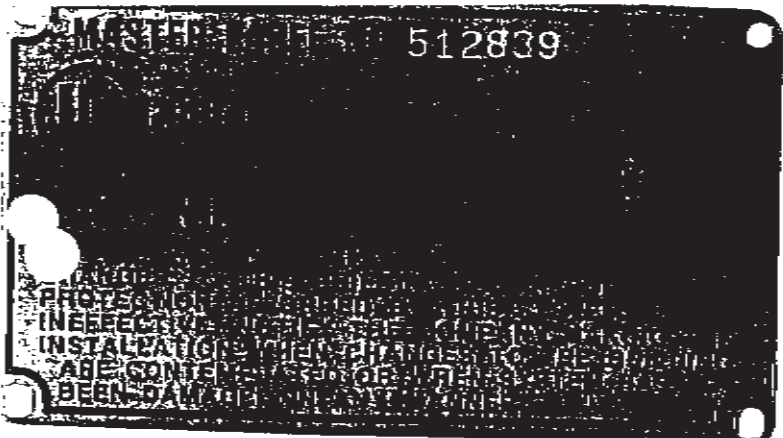


Installer W. J. ...
 This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS E24(96-3)
 for lightning protection installations to be forwarded to
 Owner ...

Address

Building	Master Label
...	No
...	No
...	No
...	No
...	No
...	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.

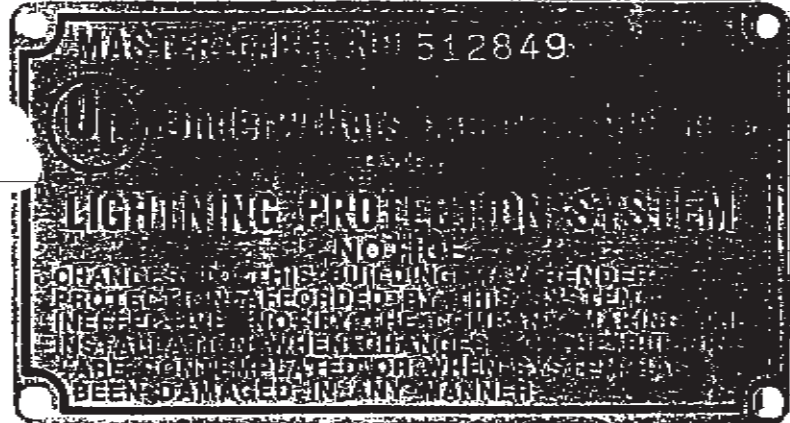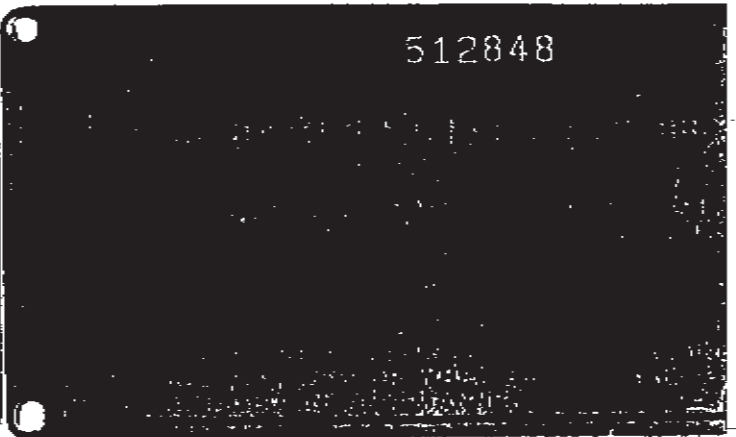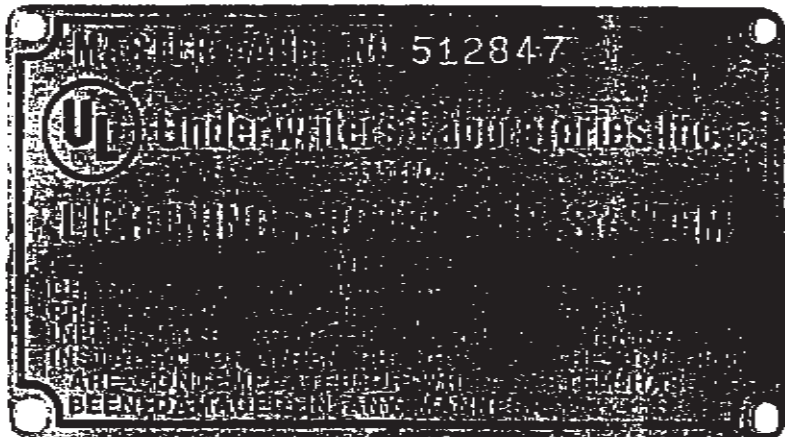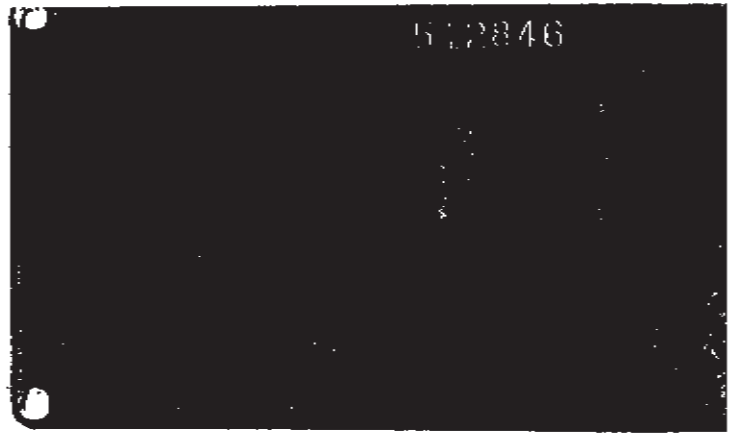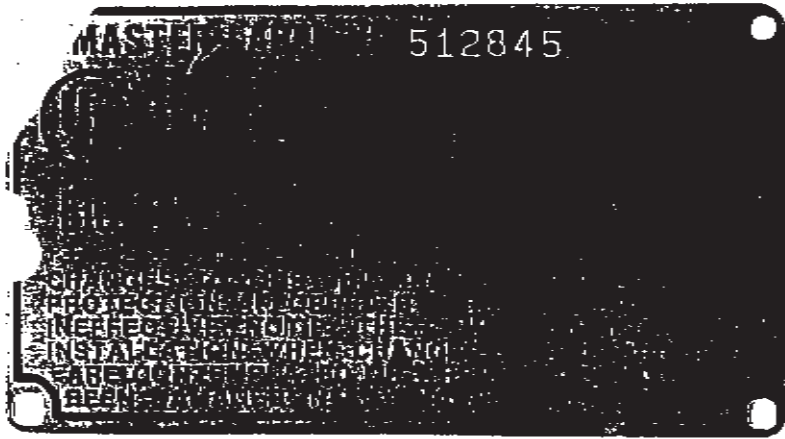

Installer

W. A. W. C.

This contains UNDERWRITERS LABORATORIES INC.'S MASTER LABELS for lightning protection installations to be forwarded to

E24(96-3)

Owner

W. A. W. C. Construction Complex

Address

Building	Master Label
<i>11</i>	No <i>5121-5</i>
<i>11</i>	No <i>6</i>
<i>6</i>	No <i>7</i>
<i>1</i>	No <i>1</i>
<i>1</i>	No <i>7</i>
	No

Owner: AS SOON AS RECEIVED, PLEASE ATTACH THE LABELS as numbered to buildings as named. Locate adjacent to the Installer's nameplate.



**MAXWELL
LIGHTNING PROTECTION COMPANY**
881 POND STREET DAYTON, OHIO 45402

GROUND ROD REPORT

Employee Delbert Corn, Jr. Date 07/29/94
 Job No. 92187 Job Name Mt. Olive Correctional Contractor Nitro
 Equipment Name Biddle Equipment Serial No. 5633
 Soil Conditions Rock Weather Conditions Clear
 Approximate Temperature 75° Approximate Last Rainfall 48 hrs +

GROUND ROD DEPTH INDIVIDUAL GRD. NO. READING RANGE SETTING

DEPTH	INDIVIDUAL GRD. NO.	READING	RANGE SETTING
2'	system	1.5 Ohms	

Signatures:
Delbert Corn, Jr. Contractor
 Maxwell Employee
7/29/94 Date
 _____ Owner or Representative
 _____ Date
 _____ Date