



State of West Virginia
 Department of Administration
 Purchasing Division
 2019 Washington Street East
 Post Office Box 50130
 Charleston, WV 25305-0130

Solicitation

NUMBER
DEP16187

PAGE
1

ADDRESS CORRESPONDENCE TO ATTENTION OF:
FRANK WHITTAKER 304-558-2316

RFQ COPY
 TYPE NAME/ADDRESS HERE

VENDOR

SHIP TO

ENVIRONMENTAL PROTECTION
 DEPARTMENT OF
 OFFICE OF AML&R
 601 57TH STREET SE
 CHARLESTON, WV
 25304 304-926-0499

DATE PRINTED
05/06/2013

BID OPENING DATE: 05/22/2013 BID OPENING TIME 1:30PM

LINE	QUANTITY	UOP	CAT. NO.	ITEM NUMBER	UNIT PRICE	AMOUNT
ADDENDUM NO. 2						
1. ADDENDUM IS ISSUED TO MOVE THE BID OPENING DATE FROM: MAY 07, 2013 TO: MAY 22, 2013 THE BID OPENING TIME OF 1:30 P.M. REMAINS UNCHANGED.						
2. TO PROVIDE ANSWER TO QUESTIONS SUBMITTED REGARDING THE ORIGINAL SOLICITATION.						
3. TO PROVIDE REVISED DRAWINGS TO SUPERSEDE ORIGINAL DETAILS AS DEFINED IN THE ATTACHED PROFILE VIEWS.						
4. TO PROVIDE VENDORS A COPY OF THE MANDATORY PRE-BID SIGN-IN SHEET. PLEASE REFER TO ATTACHMENT A FOR ALL OF THE ABOVE DOCUMENTATIONS.						
5. TO INCLUDE REVISED CONTRACTOR'S BID SHEET. PLEASE REFER TO ATTACHMENT B FOR THE REVISED BID SHEET.						
6. TO PROVIDE ADDENDUM ACKNOWLEDGEMENT. THIS DOCUMENT SHOULD BE SIGNED AND RETURNED WITH YOUR BID. FAILURE TO SIGN AND RETURN MAY RESULT IN THE DISQUALIFICATION OF YOUR BID.						
END OF ADDENDUM NO. 2						

SIGNATURE		TELEPHONE	DATE
TITLE	FEIN	ADDRESS CHANGES TO BE NOTED ABOVE	

WHEN RESPONDING TO SOLICITATION, INSERT NAME AND ADDRESS IN SPACE ABOVE LABELED 'VENDOR'



State of West Virginia
 Department of Administration
 Purchasing Division
 2019 Washington Street East
 Post Office Box 50130
 Charleston, WV 25305-0130

Solicitation

NUMBER
DEP16187

PAGE
2

ADDRESS CORRESPONDENCE TO ATTENTION OF:
FRANK WHITTAKER 304-558-2316

RFQ COPY
 TYPE NAME/ADDRESS HERE

VENDOR

SHIP TO

ENVIRONMENTAL PROTECTION
 DEPARTMENT OF
 OFFICE OF AML&R
 601 57TH STREET SE
 CHARLESTON, WV
 25304 304-926-0499

DATE PRINTED
05/06/2013

BID OPENING DATE: 05/22/2013 BID OPENING TIME 1:30PM

LINE	QUANTITY	UOP	CAT. NO.	ITEM NUMBER	UNIT PRICE	AMOUNT
0001	1	JB		962-73		
RECLAMATION: RESTORATION OF LAND & OTHER PROPERTIES						
***** THIS IS THE END OF RFQ DEP16187 ***** TOTAL:						

SIGNATURE		TELEPHONE	DATE
TITLE	FEIN	ADDRESS CHANGES TO BE NOTED ABOVE	

WHEN RESPONDING TO SOLICITATION, INSERT NAME AND ADDRESS IN SPACE ABOVE LABELED 'VENDOR'

SOLICITATION NUMBER: DEP16187

Addendum Number: 2

The purpose of this addendum is to modify the solicitation identified as (“Solicitation”) to reflect the change(s) identified and described below.

Applicable Addendum Category:

- Modify bid opening date and time
- Modify specifications of product or service being sought
- Attachment of vendor questions and responses
- Attachment of pre-bid sign-in sheet
- Correction of error
- Other

Description of Modification to Solicitation:

1. Addendum issued to move bid opening date from May 07, 2013 to May 22, 2013 at 1:30 P.M.
2. To provide Questions and Answers regarding the original RFQ.
3. To provide revised drawings.
4. To provide mandatory pre-bid sign-in sheet.
5. To provide revised Contractor's Bid Sheet
6. To provide Addendum Acknowledgement.

Additional Documentation: Documentation related to this Addendum (if any) has been included herewith as Attachment A and is specifically incorporated herein by reference.

Terms and Conditions:

1. All provisions of the Solicitation and other addenda not modified herein shall remain in full force and effect.
2. Vendor should acknowledge receipt of all addenda issued for this Solicitation by completing an Addendum Acknowledgment, a copy of which is included herewith. Failure to acknowledge addenda may result in bid disqualification. The addendum acknowledgement should be submitted with the bid to expedite document processing.

ATTACHMENT A

1. Questions and Answer page
2. Mandatory Pre-bid Sign-in Sheet
3. Revised Detailed Drawings.

DEP16187
Wheatley Branch (Luthy) Portals
Addendum #2

- Item 1: The Contractor shall have 180 days from the date of the Notice to Proceed to complete construction activities on the project. The \$250 per day liquidated damage clause will be in effect after the 180 days. However, the total performance period will be 365 days from the date of the Notice to Proceed for invoicing purposes.
- Item 2: Statement - Bat gate mine seals must be installed between the dates of May 1 and August 31.
- Item 3: Q - Are most of the bat gates above the elevation of the proposed access road?
A - Yes, all bat gates are above the elevation of the proposed access road.
- Item 4: Q - Does the stone on this project (specified in section 7.2.1) have to be from an approved WV Division of Highways source, or can it just meet the gradation tests?
A - The source of material used in this project must be approved by the WVDEP prior to delivery.
- Item 5: Q - Does the "laydown" area shown on sheet 20 need to be put back?
A - Yes, the "laydown" area must be reclaimed to its' original or better condition, which is currently a yard.
- Item 6: Q - Is there another way/route to the bench the portals are on?
A - The only access route approved by WVDEP is the access shown on the drawings (sheet 20), and the bid sheet is based on that access route.
- Item 7: Q - Will the WVDEP pay for alternate access if the winning bidder can secure a different access route?
A - At this time, we are aware of only one (1) permissible and approved access to the site. For consistency and bidding purposes, you should submit your bid based on the access illustrated in the plans.
- Item 8: Q - What about the low hanging utility wires above the proposed access route?
A - If the wires cannot be avoided by the contractor, they will need to be relocated by the local utility companies affected.
- Item 9: Q - Some debris was observed below the bench, does it need to be removed.
A - No. Only debris in or beside the portals needs to be removed.
- Item 10: Q - Does the bench the portals are on need to be regraded?
A - No. It needs to be maintained in its' present condition without any change to the slope as it exists now. However, the bench must be revegetated after project completion. As we observed, the bench is in good condition. At the end of the project, the bench must be restored to an equal or better condition. Dependent on the amount of degradation during construction/reclamation, this may, or may not, require regrading.
-

DEP16187
Wheatley Branch (Luthy) Portals
Addendum #2

- Item 11: Q - Does bid item 6.0 (revegetation) include the area of the bench that needs to be revegetated?
A - The bid sheet has been revised to add an additional 3 acres for revegetation. The revised bid sheet is included as part of this addendum.
- Item 12: Q - Is silt fence required along the entire length of the bench?
A - No. Silt fence is needed only where shown on the drawings. However, the bid item for silt fence has been increased to allow utilization as directed by the Engineer.
- Item 13: Q - How many bat gates are there, and are they all culverted?
A - For bidding purposes, there are ten. All the proposed bat gates are designed with culverts. The drawings have each portal labeled with the proposed seal type.
- Item 14: Q - Will all the mine seals have conveyance pipes across the bench?
A - No. They will drain to splash pads. We are concerned with the effective sealing of portals on this project. A revised seal drawing has been attached. We do not desire to infringe on the existing bench with any part of the mine seal (soil cover, pipes, etc.). It appears that most portals are recessed enough to permit the installation of a normal seal with a 2:1 cover slope. There are several portals where the proximity to the bench prohibits a 2:1 cover slope. In these cases, the cover slopes, pipes, etc. will be adjusted accordingly. Also, it should be noted that almost all of the portals are dry. Wet seal portals will discharge onto a splash pad and therefore the mine pipes (conveyance pipes) should not extend onto the bench. Revised mine seal drawings (for wet seal, modified wet seal, and bat gate) are attached as Items 21, 22, and 23 below. The revised mine seal drawings are to replace the original profile drawings on Sheets 32, 33 and 34.
- Item 15: Q - Can brush and timber be windrowed or burned, or can root balls be buried, and where does cut timber need to be stockpiled?
A - No burning will be allowed on the bench, since it has coal refuse on it in various places. If burning is proposed in an area not on the bench, a burning permit will need to be obtained from the WV Division of Forestry. Windrowing is not permitted. Root balls will not be allowed to be buried. Small material (i.e. less than eight (8) inches in diameter) will be chipped and utilized as mulch on the bench and on either side of the bench, or as directed by the WVDEP. Timber eight (8) inches (and greater) in diameter shall be saw cut and stockpiled for the property owner at a location designated by the Engineer. For bidding purposes, assume material to be stockpiled at their present location, off to the side of the bench.
- Item 16: Q - Do the drill roads need to be reclaimed after the piezometers are removed?
A - Yes. They need to be reclaimed and revegetated.
-
- Item 17: Q - If we hit rock on channel 1 on sheet 19, do we have to chip into the rock?
A - This channel has a minimum depth of 1 ft. It looks as if the existing channel depth is already 1 ft. or greater. No, if you encounter solid rock, it does not have to be removed to maintain depth.

DEP16187
Wheatley Branch (Luthy) Portals
Addendum #2


- Item 18: Q - How high on the highwall do the mine seals need to be backfilled? (Sheets 33 and 34 both indicate a 2H:1V final slope.)
A - There is no desire to reclaim the highwall on this project. We are only concerned with the effective sealing of portals. The backfill should be placed to approximately 2 feet above the coal seam. Please see comments under Item 14 above.
- Item 19: Q - What is beyond portal 1, and is there an alternate access route from that direction?
A - The area to the west of portal 1 (on sheet 16) is not within the construction work limits of this project. The WVDEP does not believe there is a better access route from that direction, and did not investigate this, or get any property rights of entry. As stated earlier, the access to this project is designed to be as shown on sheet 20.
- Item 20: Statement. The buried gas line that crosses the project is shown on sheet 20 in the vicinity of station 54+00. It is the contractor's responsibility to contact the utility to determine if any precautions are necessary when crossing the pipeline with equipment.

DEP16187
 Wheatley Branch (Luthy) Portals
 Addendum #2

Item 21: This revised wet mine seal profile view should replace the profile view on Sheet 32.

NOTES:

1. TWO (2) JOINTS (28.0 FEET) OF MINE SEAL OUTLET PIPES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR "WET MINE SEALS" REGARDLESS OF WHERE THESE PIPES END IN THE INSTALLATION.
2. THE MINE SEAL CONVEYANCE PIPE LENGTHS VARY AND SHALL BE INCLUDED IN THE UNIT PRICE BID FOR "MINE SEAL CONVEYANCE PIPES". MINE SEAL CONVEYANCE PIPES BEGIN AT THE END OF THE MINE SEAL OUTLET PIPES AND EXTEND TO THE PLANNED OUTFALL.
3. THE PERFORATED END CAP LOCATED INSIDE THE MINE AT THE END OF THE ONE TO THREE FOOT (1.0' TO 3.0') STUB SHALL HAVE A RUBBER GASKET, PLACED ON THE UPSTREAM END OF THE STUB AND SCREWED IN PLACE.
4. THE STONE BULKHEAD SHALL BE IN CONTACT WITH COAL ROOF FOR A DISTANCE EQUAL TO THE OPENING HEIGHT OR A MINIMUM OF 6.0 FEET. THE INSIDE AND OUTSIDE STONE BULKHEAD FACES SHALL BE CONSTRUCTED AT THE ANGLE OF REPOSE OF THE NO. 4 NON-CALCAREOUS STONE PLACED.
5. 1 1/2" CRUSHER RUN STONE SHALL MEET THE GRADATION REQUIREMENTS FOR CLASS 1 AGGREGATE IN TABLE 704.6.2A OF THE WVDOT SPECIFICATIONS FOR ROADS AND BRIDGES.

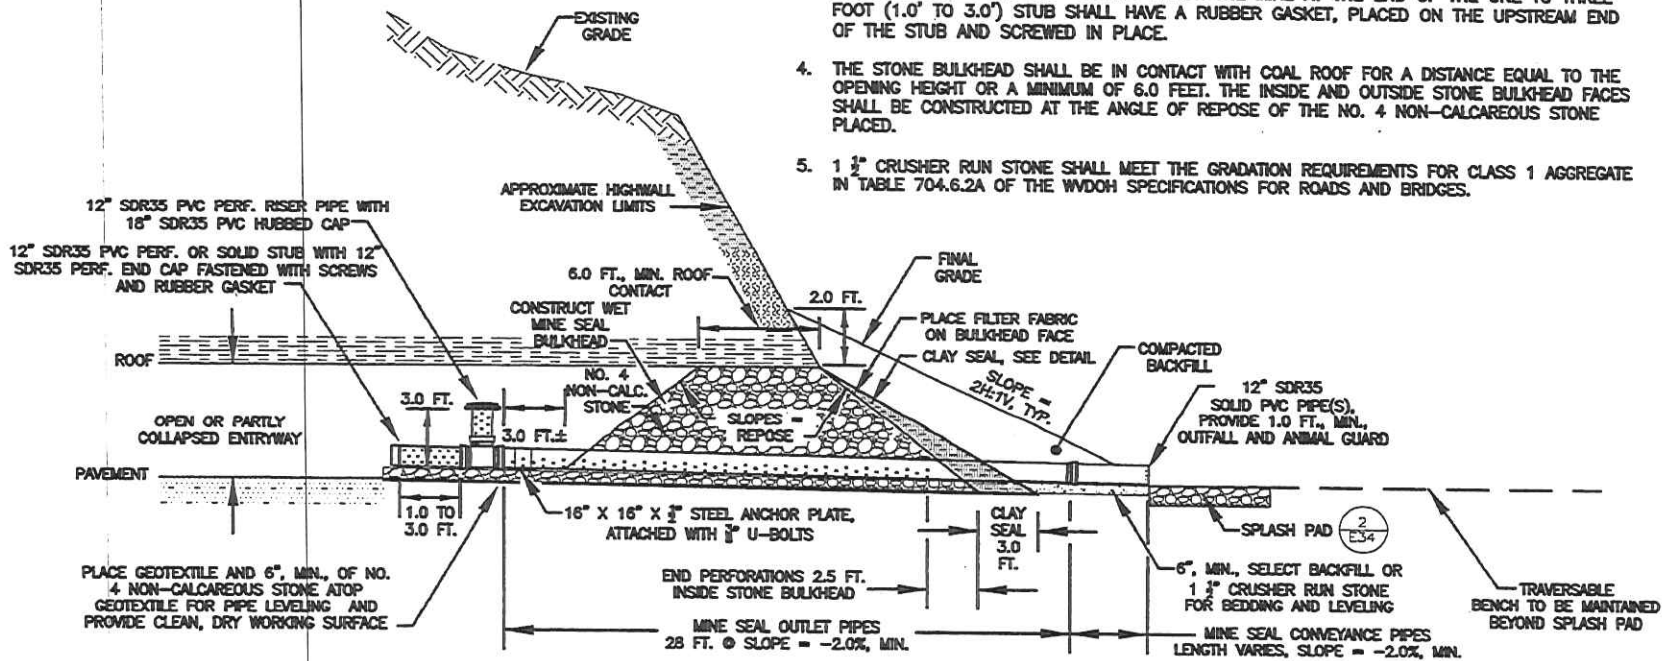


PROFILE VIEW, TYP.

WET SEAL
 NOT TO SCALE




DEP16187
 Wheatley Branch (Luthy) Portals
 Addendum #2

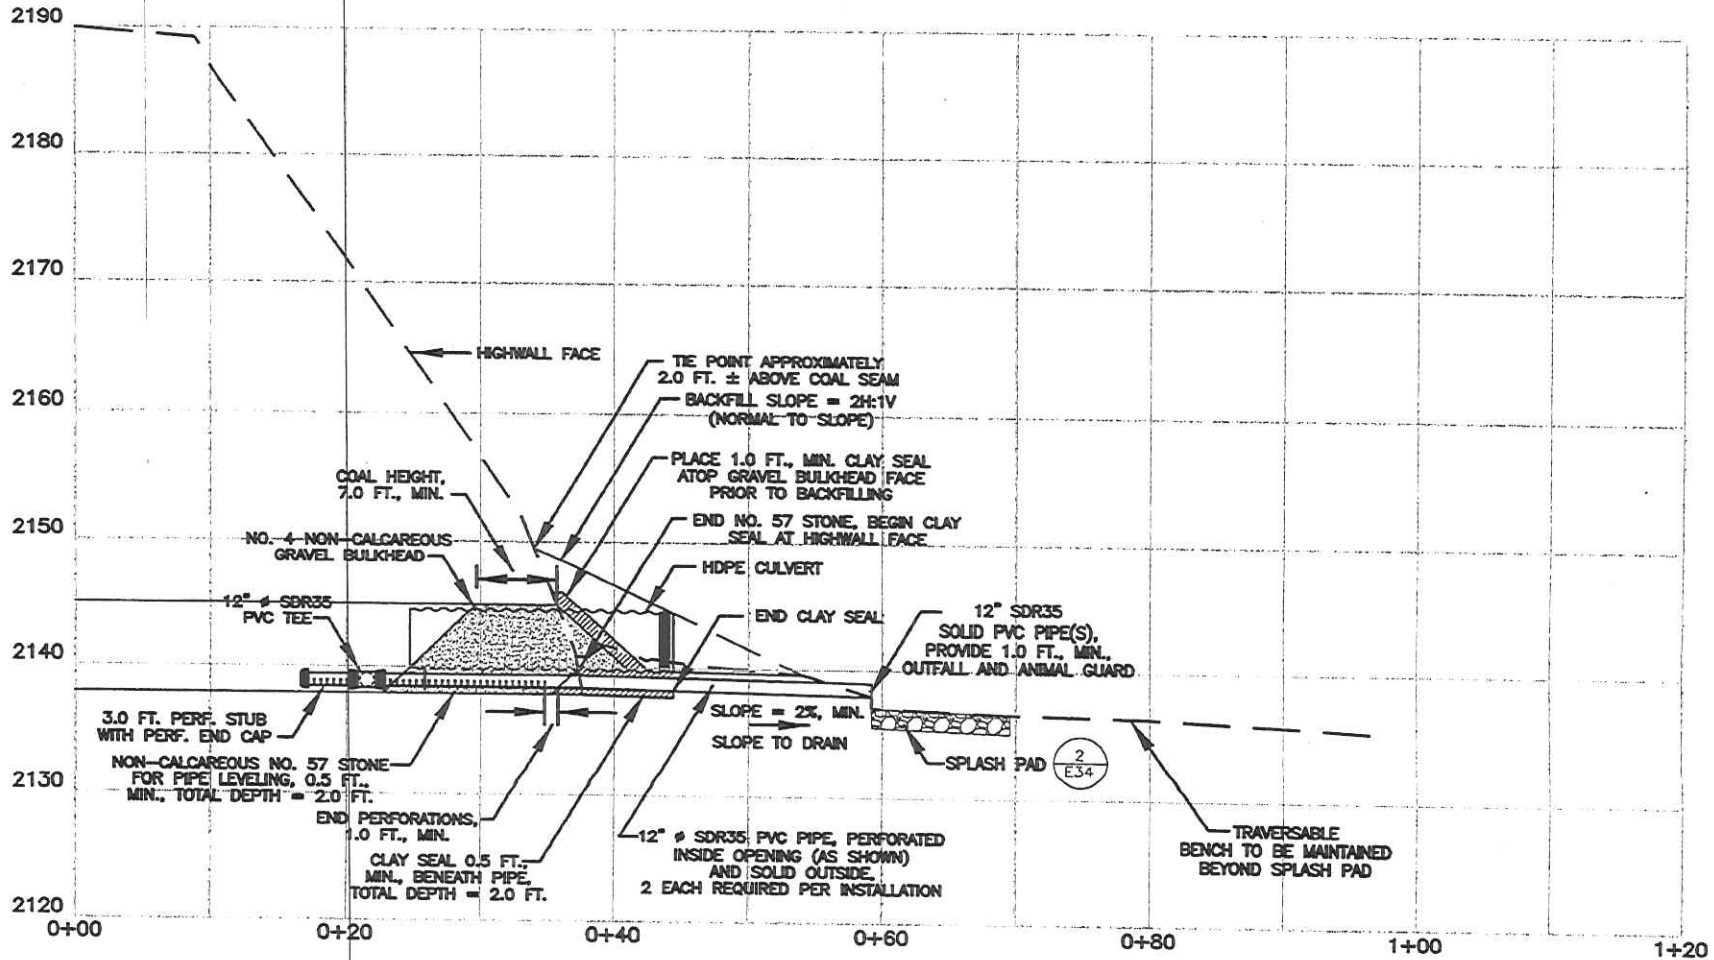


PROFILE, TYP.

BAT GATE



Item 22: This revised bat gate seal profile view should replace the typical profile on Sheet 33.

Item 23: This revised modified seal detail should replace the profile view on Sheet 34.

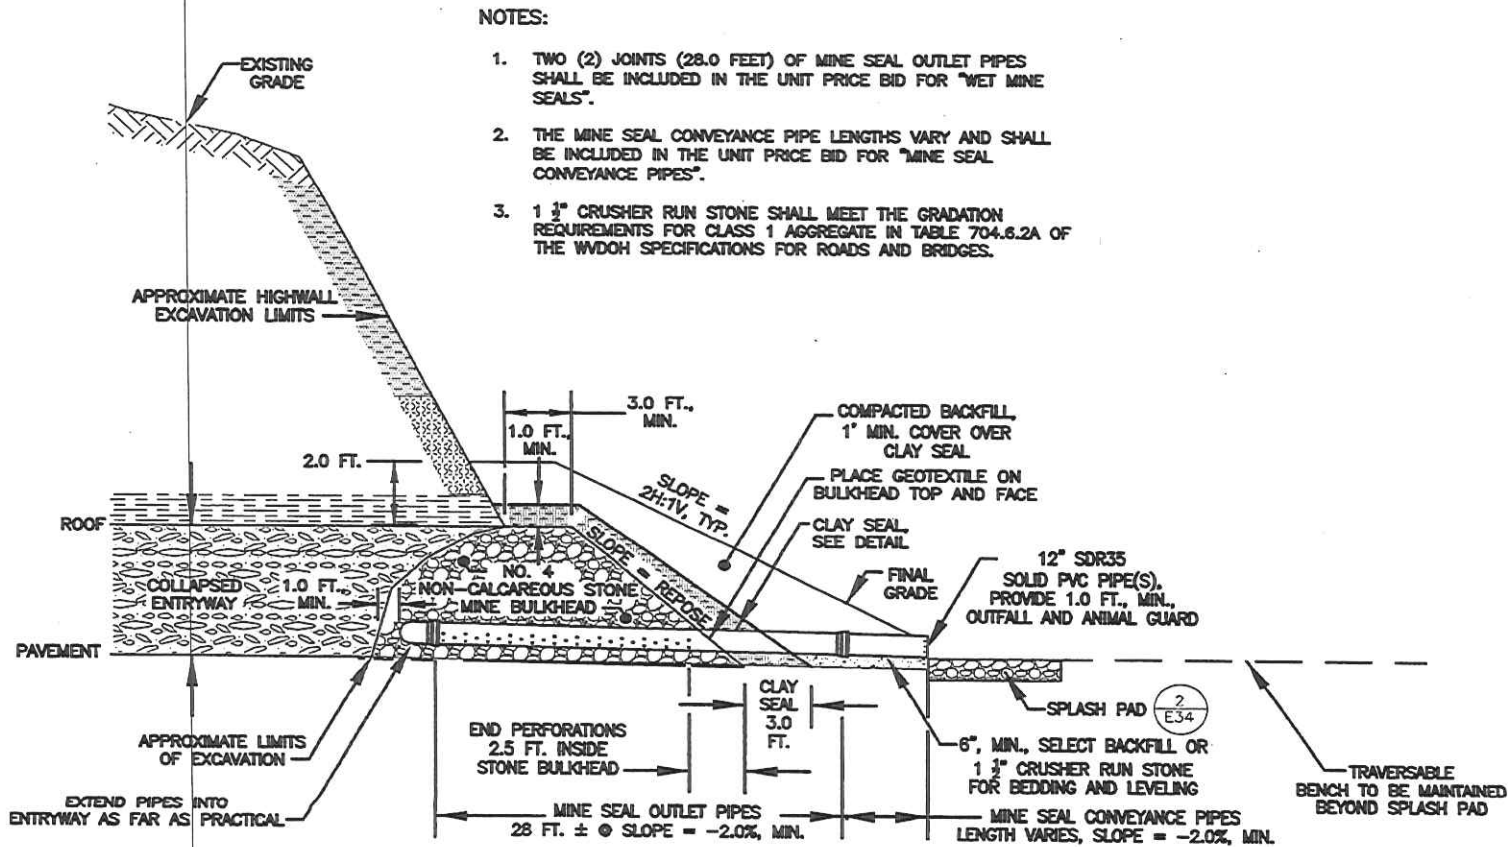


NOTES:

1. TWO (2) JOINTS (28.0 FEET) OF MINE SEAL OUTLET PIPES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR "WET MINE SEALS".
2. THE MINE SEAL CONVEYANCE PIPE LENGTHS VARY AND SHALL BE INCLUDED IN THE UNIT PRICE BID FOR "MINE SEAL CONVEYANCE PIPES".
3. 1 1/2" CRUSHER RUN STONE SHALL MEET THE GRADATION REQUIREMENTS FOR CLASS 1 AGGREGATE IN TABLE 704.6.2A OF THE WDOH SPECIFICATIONS FOR ROADS AND BRIDGES.

PROFILE VIEW

MODIFIED MINE SEAL

NOT TO SCALE



REQUEST FOR QUOTATION NO. DEP16187

SIGN IN SHEET

Page 1 of 4

Wheatley Branch (Luthy) Portals

PLEASE PRINT

Date: April 23, 2013

* PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>BARNES EXC TMC</u> Rep: <u>Robert L. Barnes</u> Email Address: <u>BARNES EXC(A) AOL.COM</u>	<u>P.O. Box 13384</u> <u>Sissonville</u> <u>WV 25360</u>	PHONE <u>304-984-1725</u> TOLL FREE FAX <u>304-984-0074</u>
Company: <u>Emd R Excavating</u> Rep: <u>Andrew Goodrite</u> Email Address: <u>erexcavating@frontiernet.net</u>	<u>2357 Broad Run Rd</u> <u>Po Box 655</u> <u>New Haven WV 25265</u>	PHONE <u>304-882-2271</u> TOLL FREE FAX <u>304-882-8238</u>
Company: <u>Wildcat Exc</u> Rep: <u>DANA L. POKED</u> Email Address: _____	<u>P.O. Box 189</u> <u>Logan, WV 25601</u>	PHONE <u>304-687-5154</u> TOLL FREE FAX _____
Company: <u>GREEN Mountain COMPANY</u> Rep: <u>DAVID H. BOWMAN</u> Email Address: <u>DHB 7224@yahoo.com</u>	<u>511 50th ST</u> <u>Charleston WV</u> <u>25304</u>	PHONE <u>304 925 0253</u> TOLL FREE <u>☎</u> FAX <u>304-925-9230</u>
Company: <u>WISEMAN EXCAVATING</u> Rep: <u>Bruce Wiseman</u> Email Address: _____	<u>RT 1 BOX 190 LIBERTY WV</u> <u>25124</u>	PHONE <u>304-586-3736</u> TOLL FREE FAX <u>304-586-3780</u>

REQUEST FOR QUOTATION NO. **DEP16187**

SIGN IN SHEET

Page 2 of 4

Wheatley Branch (Luthy) Portals

PLEASE PRINT

Date: April 23, 2013

* PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>BURNS EXCAVATING</u> Rep: <u>Jeremy Singleton</u> Email Address: <u>CARL@Knobleyfarmsportshop.com</u>	<u>HC 75 Box 33</u> <u>NEW CREEK WV 26743</u>	PHONE <u>304-813-5943</u> TOLL FREE <u>304-257-0570</u> FAX
Company: <u>Breakaway Inc</u> Rep: <u>Doug Vincent</u> Email Address: <u>doug@breakaway.wv.com</u>	<u>1075 Old Turnpike Rd</u> <u>Sutton WV 26601</u>	PHONE <u>765-5317</u> TOLL FREE FAX <u>765-5389</u>
Company: <u>EAGLE EXCAVATION INC.</u> Rep: <u>GEORGE FRESHOUR</u> Email Address: <u>NONE</u>	<u>P.O. BOX 218</u> <u>KENNA, WV 25248</u>	PHONE <u>(304) 372-4378</u> TOLL FREE FAX <u>(304) 372-4378</u>
Company: <u>EASTERN Arrow</u> Rep: <u>Ann Wanswell</u> Email Address: <u>easternarrow@hotmail.com</u>	<u>Box 4109</u> <u>CHARLESTON WV</u> <u>25361</u>	PHONE <u>304-411-0255</u> TOLL FREE FAX <u>0255</u>
Company: <u>Smith Bros Etc.</u> Rep: <u>STANLEY Smith</u> Email Address:	<u>729 Highway 149</u> <u>MANCHESTER KY</u> <u>40962</u>	PHONE <u>606-599-6726</u> TOLL FREE FAX <u>598-5670</u>

REQUEST FOR QUOTATION NO. DEP16187

SIGN IN SHEET

Page 3 of 4

Wheatley Branch (Luthy) Portals

PLEASE PRINT

Date: April 23, 2013

* PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>Withcat Eye</u> Rep: <u>Dennis L. Hawks</u> Email Address: _____	_____ _____ _____	PHONE _____ TOLL _____ FREE _____ FAX _____
Company: <u>BLUE LINE STREAM</u> Rep: <u>ADAM SMITH</u> Email Address: <u>bluelinestream@yahoo.com</u>	<u>111 Honeybee dr</u> <u>Louisia KY</u> <u>41230</u>	PHONE <u>606 422-0683</u> TOLL _____ FREE _____ FAX _____
Company: <u>FOSTER SUPPLY</u> Rep: <u>DERRICK SEARS</u> Email Address: <u>dsears@fostersupply.com</u>	<u>PO Box 488</u> <u>SCOTT DEPOT WV 25860</u>	PHONE <u>304-553-6565</u> TOLL _____ FREE _____ FAX <u>304-755-8280</u>
Company: <u>Aspen Corporation</u> Rep: <u>Ashley Allins</u> Email Address: <u>jadkins@aspen-golf.com</u>	<u>2400 River Drive</u> <u> Daniels WV 25832</u>	PHONE <u>304-763-4573</u> TOLL _____ FREE _____ FAX <u>304-763-4591</u>
Company: <u>Thaxton Construction Co, Inc.</u> Rep: <u>Dustin Thaxton</u> Email Address: <u>thaxtonconstruction@gmail.com</u>	<u>P.O. Box 13274</u> <u>Charleston, WV 25360</u>	PHONE <u>304-984-2299</u> TOLL _____ FREE _____ FAX <u>304-984-2334</u>

REQUEST FOR QUOTATION NO. DEP16187

SIGN IN SHEET

Page 4 of 4

Wheatley Branch (Luthy) Portals

PLEASE PRINT

Date: April 23, 2013

* PLEASE BE SURE TO PRINT LEGIBLY - IF POSSIBLE, LEAVE A BUSINESS CARD

FIRM & REPRESENTATIVE NAME	MAILING ADDRESS	TELEPHONE & FAX NUMBERS
Company: <u>Pineville Paving & Excavating Inc.</u> Rep: <u>Tony Bradford</u> Email Address: _____	<u>P.O. 1290 Pineville WV 24874</u>	PHONE <u>304-732-8303</u> TOLL FREE FAX <u>304-732-7855</u>
Company: <u>ABC Excavation LLC</u> Rep: <u>Josh McNeely</u> Email Address: <u>joshmcneely6@gmail.com</u>	<u>PO Box 44 Foster, WV 25081</u>	PHONE <u>304 369 6798</u> TOLL FREE FAX _____
Company: <u>McCourt & Son Const.</u> Rep: <u>Gary Long</u> Email Address: <u>glong@wirefire.com</u>	<u>2790 Centralia Rd</u> <u>Sutton WV 26601</u>	PHONE <u>304 765-5288</u> TOLL FREE FAX <u>304 765-5293</u>
Company: <u>Carpenter Reclamation</u> Rep: <u>Randy Carpenter</u> Email Address: <u>Rcarp@msaol.com</u>	<u>PO BX 13015</u> <u>5:550AVille WV 25360</u>	PHONE <u>304 984-1115</u> TOLL FREE FAX <u>304 984-2776</u>
Company: <u>Hi-TECH CO.</u> Rep: <u>mark moss</u> Email Address: <u>Janet@hitechconston.com</u>	<u>South Charleston WV</u>	PHONE <u>304-746-0050</u> TOLL FREE <u>1-800-233-6809</u> FAX <u>304-746-4452</u>

ATTACHMENT B

1. Revised Contractor's Bid Sheet

Wheatley Branch (Luthy) Portals

Requisition # DEP16187

Contractor's Bid Sheet
(Revised for Addendum)

Company Name: _____

Address: _____

The DEP reserves the right to request additional information and supporting documentation regarding unit prices when the unit price appears to be unreasonable.

ITEM NO.	QUANTITY	DESCRIPTION	UNIT PRICE	AMOUNT
1.0	1	"Mobilization and Demobilization," per lump sum. Cannot be more than 10% of the Total Amount Bid for the project.	l.s.	\$
2.0	1	"Construction Layout," per lump sum. Cannot be more than 3% of the Total Amount Bid for the project.	l.s.	\$
3.0	1	"Quality Control," per lump sum. Cannot be more than 3% of the Total Amount Bid for the project.	l.s.	\$
4.1	1	"Site Preparation," per lump sum. Cannot be more than 10% of the Total Amount Bid for the project.	l.s.	\$
4.2	450	"Class 1 Aggregate," per ton	\$	\$
4.3	1	"Temporary Access Road," per lump sum	l.s.	\$
4.4	1	"Temporary 42-inch Diameter Culvert," per lump sum	l.s.	\$
4.5	40	"Road Crossing 42-inch Diameter Culvert," per linear foot	\$	\$
5.1	7,500	"Silt Fence," per linear foot	\$	\$
5.2	1	"Stabilized Construction Entrance," per each	\$	\$
5.3	3	"Rock Check Dams," per each	\$	\$
6.0	6	"Revegetation," per plan view acre	\$	\$
7.1	650	"1-Foot Deep Riprap Vee Channel," per linear foot	\$	\$
7.2	100	"1-Foot Deep Grouted Riprap Vee Channel," per linear foot	\$	\$
7.3	1	"Low Water Crossing," per each	\$	\$
7.4	25	"18-inch Diameter Culvert," per linear foot	\$	\$
9.1	17	"Wet/Modified Wet Seal," per each	\$	\$
9.2	10	"Bat Gate," per each	\$	\$
9.3	100	"Soda Ash Briquettes," per 50 pound bag	\$	\$
TOTAL			\$	\$

ADDENDUM ACKNOWLEDGEMENT FORM
SOLICITATION NO.: DEP16187

Instructions: Please acknowledge receipt of all addenda issued with this solicitation by completing this addendum acknowledgment form. Check the box next to each addendum received and sign below. Failure to acknowledge addenda may result in bid disqualification.

Acknowledgment: I hereby acknowledge receipt of the following addenda and have made the necessary revisions to my proposal, plans and/or specification, etc.

Addendum Numbers Received:

(Check the box next to each addendum received)

- | | |
|---|--|
| <input type="checkbox"/> Addendum No. 1 | <input type="checkbox"/> Addendum No. 6 |
| <input type="checkbox"/> Addendum No. 2 | <input type="checkbox"/> Addendum No. 7 |
| <input type="checkbox"/> Addendum No. 3 | <input type="checkbox"/> Addendum No. 8 |
| <input type="checkbox"/> Addendum No. 4 | <input type="checkbox"/> Addendum No. 9 |
| <input type="checkbox"/> Addendum No. 5 | <input type="checkbox"/> Addendum No. 10 |

I understand that failure to confirm the receipt of addenda may be cause for rejection of this bid. I further understand that any verbal representation made or assumed to be made during any oral discussion held between Vendor's representatives and any state personnel is not binding. Only the information issued in writing and added to the specifications by an official addendum is binding.

Company

Authorized Signature

Date

NOTE: This addendum acknowledgement should be submitted with the bid to expedite document processing.
 Revised 6/8/2012