



State of West Virginia  
 Department of Administration  
 Purchasing Division  
 2019 Washington Street East  
 Post Office Box 50130  
 Charleston, WV 25305-0130

# Solicitation

NUMBER
DEFK14021

PAGE
1

ADDRESS CORRESPONDENCE TO ATTENTION OF
TARA LYLE
304-558-2544

RFQ COPY

TYPE NAME/ADDRESS HERE

VENDOR

SHIP TO

DIV ENGINEERING & FACILITIES  
 JOBSITE  
 SEE SPECIFICATIONS

DATE PRINTED
02/10/2014

BID OPENING DATE: 02/19/2014

BID OPENING TIME 1:30PM

LINE	QUANTITY	UOP	CAT NO.	ITEM NUMBER	UNIT PRICE	AMOUNT
0001		JB		968-42		
ADDENDUM NO. 4 SEE ATTACHED PAGES. END OF ADDENDUM NO. 4 1 GENERAL CONSTRUCTION						
***** THIS IS THE END OF RFQ DEFK14021 ***** TOTAL:						

SIGNATURE		TELEPHONE	DATE
TITLE	FEIN	ADDRESS CHANGES TO BE NOTED ABOVE	

WHEN RESPONDING TO SOLICITATION, INSERT NAME AND ADDRESS IN SPACE ABOVE LABELED 'VENDOR'

**SOLICITATION NUMBER: DEFK14021**  
**Addendum Number: 4**

---

The purpose of this addendum is to modify the solicitation identified as DEFK14021 ("Solicitation") to reflect the change(s) identified and described below.

**Applicable Addendum Category:**

- Modify bid opening date and time
- Modify specifications of product or service being sought
- Attachment of vendor questions and responses
- Attachment of pre-bid sign-in sheet
- Correction of error
- Other

**Description of Modification to Solicitation:**

1. The bid opening has moved from 02/11/2014 to 02/19/2014. The bid opening time remains at 1:30 pm.
2. Address electric and gas design and construction design. See attached pages.

**Additional Documentation:** Documentation related to this Addendum (if any) has been included herewith as Attachment A and is specifically incorporated herein by reference.

**Terms and Conditions:**

1. All provisions of the Solicitation and other addenda not modified herein shall remain in full force and effect.
2. Vendor should acknowledge receipt of all addenda issued for this Solicitation by completing an Addendum Acknowledgment, a copy of which is included herewith. Failure to acknowledge addenda may result in bid disqualification. The addendum acknowledgement should be submitted with the bid to expedite document processing.

ATTACHMENT A**Coonskin Park Maintenance Facility**

Addendum No.: 4

From: **Michael Baker Jr., Inc.**  
5088 Washington Street, West  
Charleston, West Virginia 25313

To: Prospective Bidders

This addendum forms a part of the Contract Documents and modifies the original Contract Documents dated **December 10, 2013**. Acknowledge receipt of this Addendum by inserting the number and issue date of this addendum in the blank space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of **1 page** and the attached documents:

C-2-4-1 -	Partial Site Utility Plan Notes	- 1 page
C-2-4-2 -	Partial Site Utility Sections	- 1 page

**CHANGES TO DRAWINGS:**

1. REVISION: – **Revise the keyed note 1 as per Attachment C-2-4-1.**
2. ADDITION: – **Add the keyed note 9 as per Attachment C-2-4-1.**
3. REVISION: – **Revise Sections A-A and B-B as per Attachment C-2-4-2.**

**END OF ADDENDUM**

# NOTES:

1. ALL CONDUITS FOR PRIMARY FEED MUST BE A MINIMUM OF 36" DEEP. CASE SCH 80 PVC CONDUIT UNDER ROAD WAY PER DETAIL B-B, CONDUIT IN OTHER LOCATIONS CAN BE SCH 40 PVC. ALL SECONDARY OR SERVICE FEEDS MUST BE A MINIMUM OF 30" DEEP.
2. CONTRACTOR SHALL PROTECT EXISTING FACILITIES THROUOUT CONSTRUCTION (I.E. SOCCER FIELD, AMPHITHEATER, ETC.).
3. CONTRACTOR SHALL INCLUDE THE COST FEES OF UTILITY CONNECTIONS IN BIDS.
4. SANITARY SEWER SHALL BE A MINIMUM OF 18" BELOW THE ELECTRICAL SERVICE AT ANY CROSSING.

4

5. AEP IS TO FURNISH THE METER BASE TO THE CONTRACTOR FOR INSTALLATION. AEP USES A 320 AMP METER BASE FOR 400A SERVICE, THIS WILL ALLOW APPROXIMATELY 100 KWs. PARALLEL 350 MCM WILL FIT THE LUGS. NO CT CABINAT IS REQUIRED. THE CONTRACTOR SHALL CONTACT AEP REPRESENTATIVE CHARLIE MAURER (304-348-4172) FOR PRICING AEP SUPPLIED MATERIALS AND LABOR. CONTRACT NUMBER DWMS00000209876, WORK REQUEST NUMBER: 50945074.
6. AEP WILL BE RESPONSIBLE FOR FURNISHING AND INSTALLING THE CONDUCTORS FOR THE PRIMARY SIDE AND FINAL POWER CONNECTIONS AT BOTH ENDS. ANY TESTING FOR HIGH VOLTAGE CABLE WILL BE THE RESPONSIBILITY OF AEP.
7. REMOVING AND REINSTALLING EXISTING FENCING TO BE AT THE DISCRESSION OF THE CONTRACTOR. THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL DAMAGE TO EXISTING COMPONENTS.
8. THE SITE UTILITY PLAN C-2 IS DIAGRAMMATIC ONLY, THE EXACT ROUTING OF UTILITIES WILL BE DICTATED BY AS FOUND FIELD CONDITIONS.

3

9. GAS LINE SHALL BE PE2406 YELLOW GAS PIPE AT A MINIMUM DEPTH OF 18". CONTRACTOR SHALL FURNISH AND INSTALL PIPE, AND SET METER LOOP PROVIDED BY THE GAS UTILITY COMPANY, LINE TESTING AND FINAL CONNECTION SHALL BE BY GAS UTILITY COMPANY.

4



**Bake**  
Michael Baker Jr., Inc.

5088 West Washington Street  
Charleston, West Virginia 25313  
Phone (304) 769-0821  
Fax (304) 769-0822

Drawing Title: <b>Site Utility Plan</b>	Date: 02/07/14
Project Coonskin Park Maintenance Facility	Project No.: 135625
Original Drawing Number <b>C-2</b>	Scale: None

Attachment Number:

**C-2-4-1**

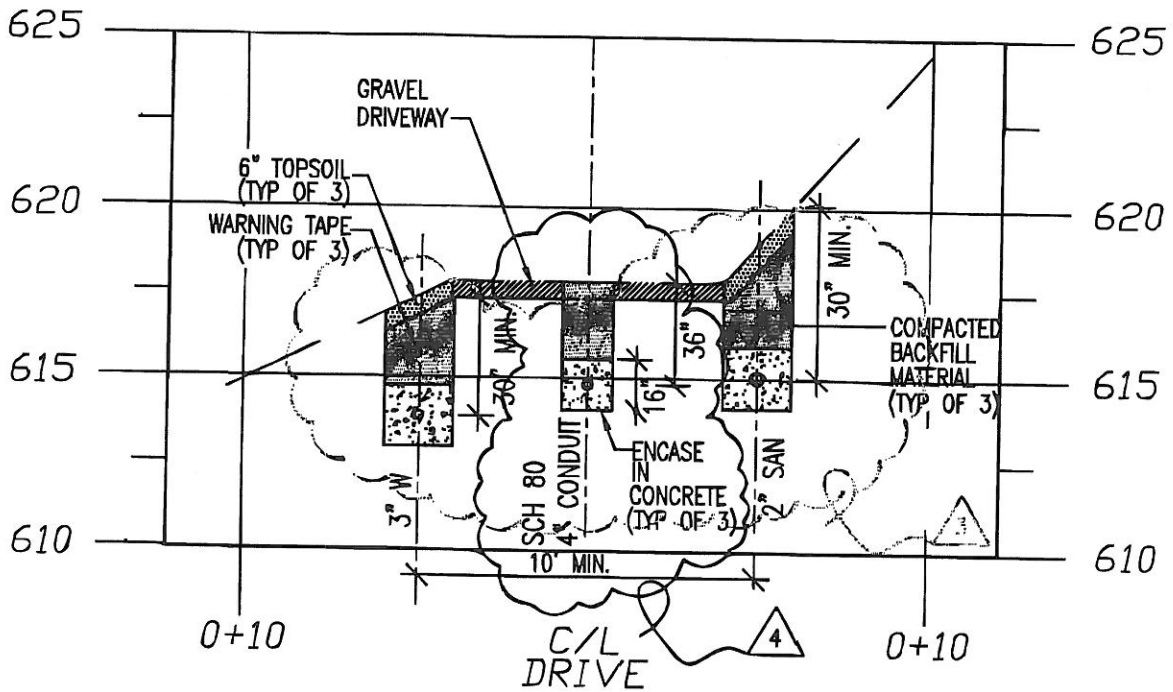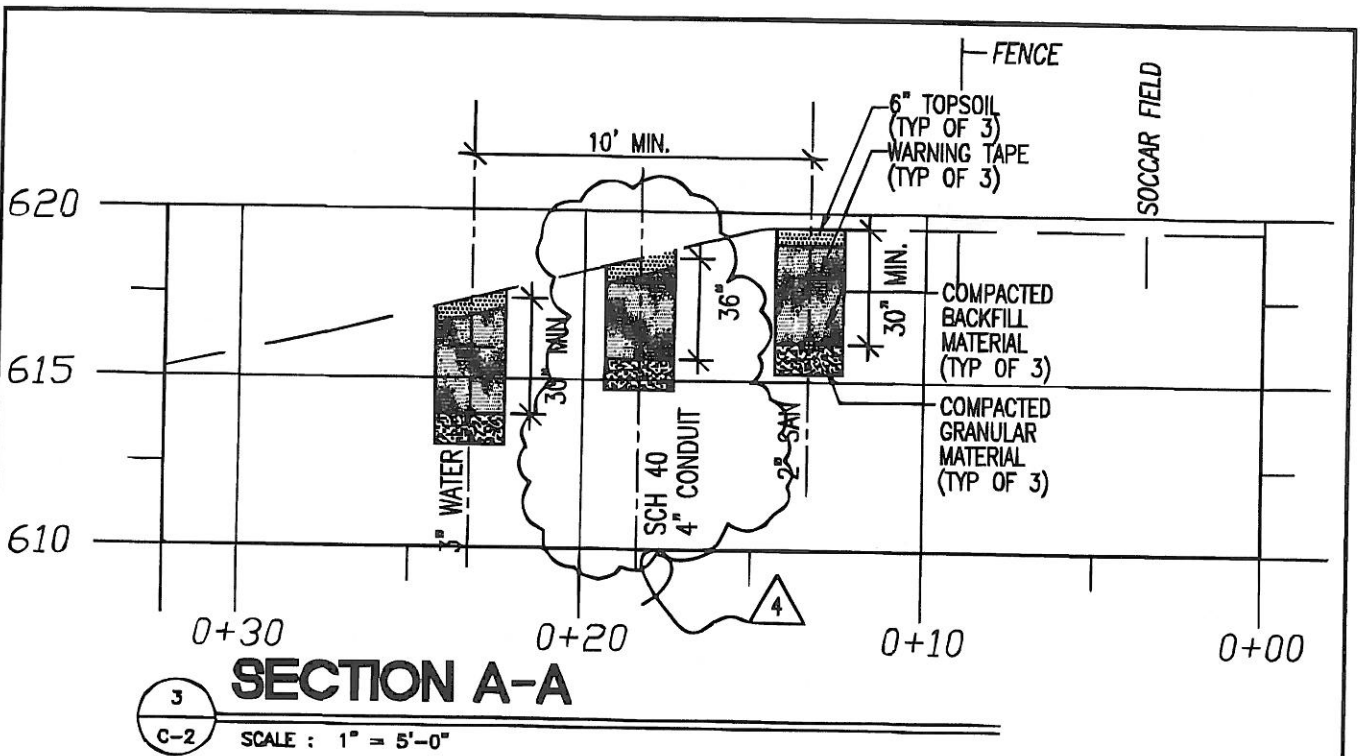

**Baker**

508B West Washington Street  
Charleston, West Virginia 25313  
Phone (304) 769-0821  
Fax (304) 769-0822

Michael Baker Jr., Inc.

Drawing Title:

**Site Utility Plan**

Project Coonskin Park Maintenance Facility

Original Drawing Number

**C-2**

Date:

02/07/14

Project No.:

135625

Scale:

None

Attachment Number:

**C-2-4-2**

**ADDENDUM ACKNOWLEDGEMENT FORM**  
**SOLICITATION NO.: DEFK14021**

**Instructions:** Please acknowledge receipt of all addenda issued with this solicitation by completing this addendum acknowledgment form. Check the box next to each addendum received and sign below. Failure to acknowledge addenda may result in bid disqualification.

**Acknowledgment:** I hereby acknowledge receipt of the following addenda and have made the necessary revisions to my proposal, plans and/or specification, etc.

**Addendum Numbers Received:**

(Check the box next to each addendum received)

- |   |  |
|---|--|
| <input type="checkbox"/> Addendum No. 1<br><br><input type="checkbox"/> Addendum No. 2<br><br><input type="checkbox"/> Addendum No. 3<br><br><input type="checkbox"/> Addendum No. 4<br><br><input type="checkbox"/> Addendum No. 5 | <input type="checkbox"/> Addendum No. 6<br><br><input type="checkbox"/> Addendum No. 7<br><br><input type="checkbox"/> Addendum No. 8<br><br><input type="checkbox"/> Addendum No. 9<br><br><input type="checkbox"/> Addendum No. 10 |
|---|--|

I understand that failure to confirm the receipt of addenda may be cause for rejection of this bid. I further understand that that any verbal representation made or assumed to be made during any oral discussion held between Vendor's representatives and any state personnel is not binding. Only the information issued in writing and added to the specifications by an official addendum is binding.

---

Company

---

Authorized Signature

---

Date

NOTE: This addendum acknowledgement should be submitted with the bid to expedite document processing.